


CLS : CLOSE LIMIT SWITCH (250VAC 15A)
 OLS : OPEN LIMIT SWITCH (250VAC 15A)
 CTS : CLOSE TORQUE SWITCH (250VAC 15A)
 OTS : OPEN TORQUE SWITCH (250VAC 15A)
 ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 5A)
 AOLS : AUX. OPEN LIMIT SWITCH (250VAC 5A)
 TP : THERMAL PROTECTOR (250VAC 15A)

CLOSE		OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
ACLS		
AOLS		
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

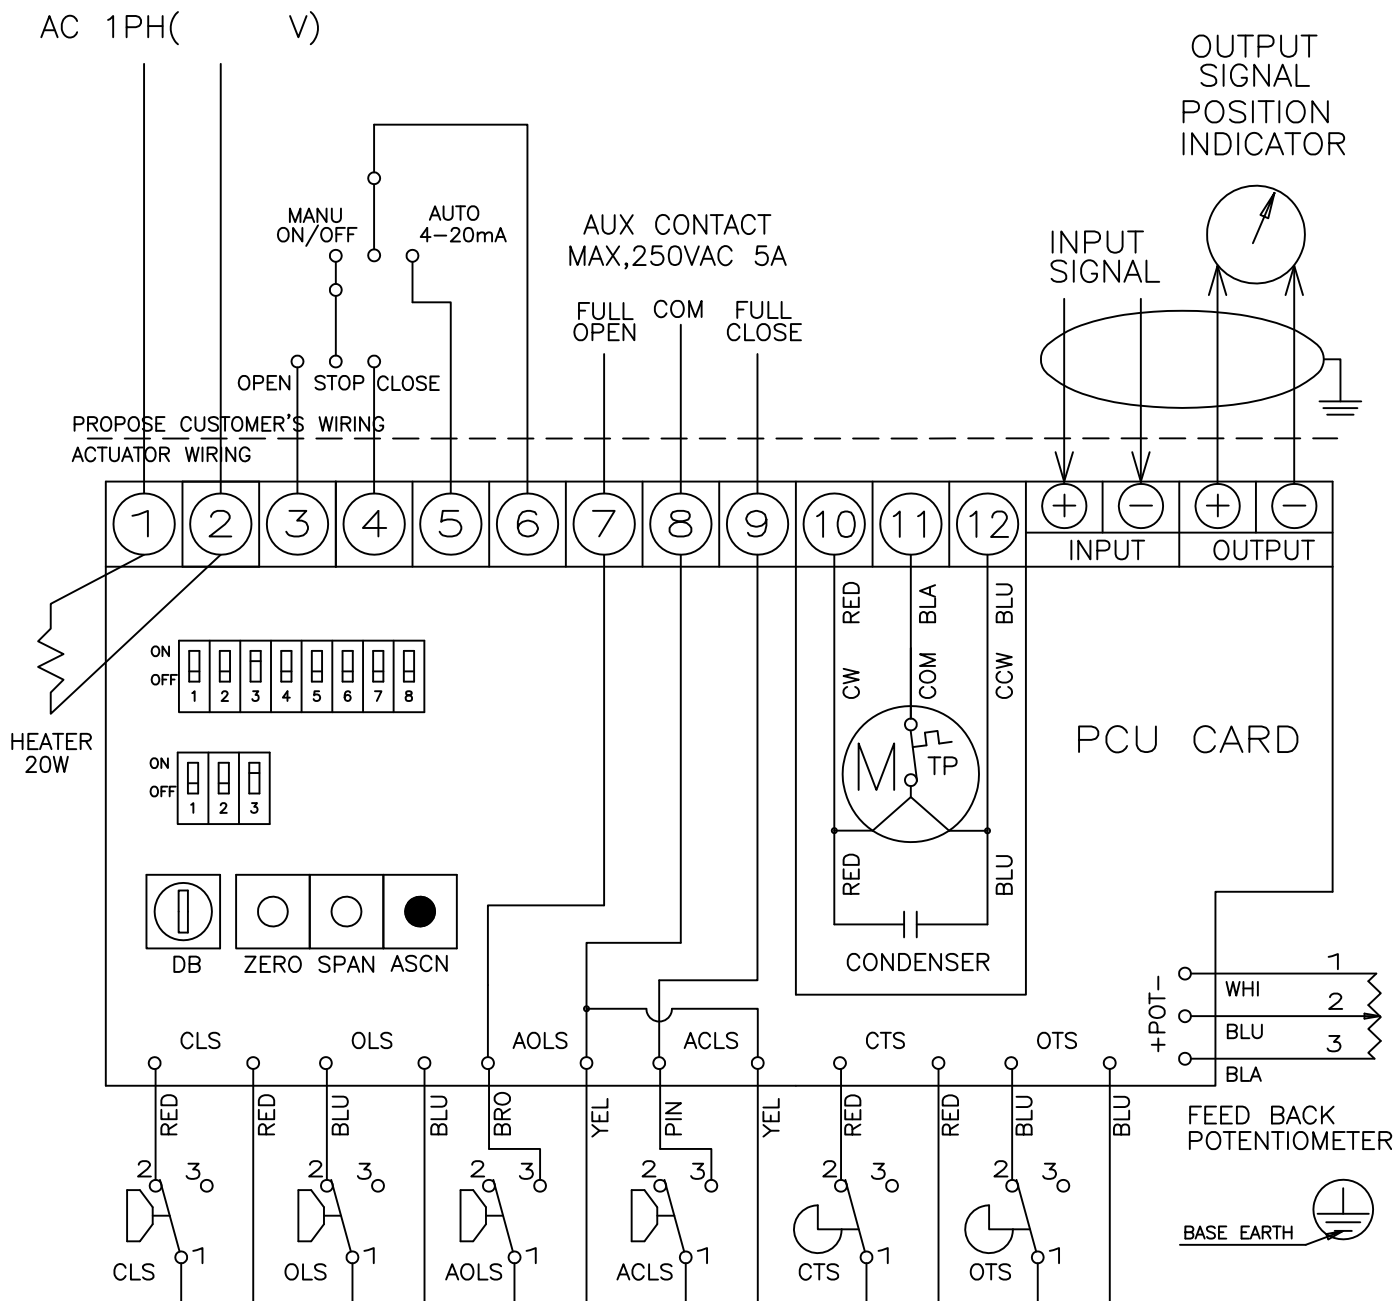

			△					
NL25	1		SYM	E C N NO	CHANGES	DATE	SIGN	APPD
NL20	1		DRAW	H,J KWON	PART NAME AC IPH WIRING DIAGRAM ALS,PCU			
NL10	1		CHECK					
NL08	1		APPD		DWG NO. LS-125EO-A			
APPLICATION			DATE '16,10,11					