


CLS : CLOSE LIMIT SWITCH (250VAC 15A)
OLS : OPEN LIMIT SWITCH (250VAC 15A)
CTS : CLOSE TORQUE SWITCH (250VAC 15A)
OTS : OPEN TORQUE SWITCH (250VAC 15A)
TP : THERMAL PROTECTOR (250VAC 15A)

CLOSE		OPEN	
CLS 1-2			
CLS 1-3			
OLS 1-2			
OLS 1-3			
CTS 1-3		* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3		* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

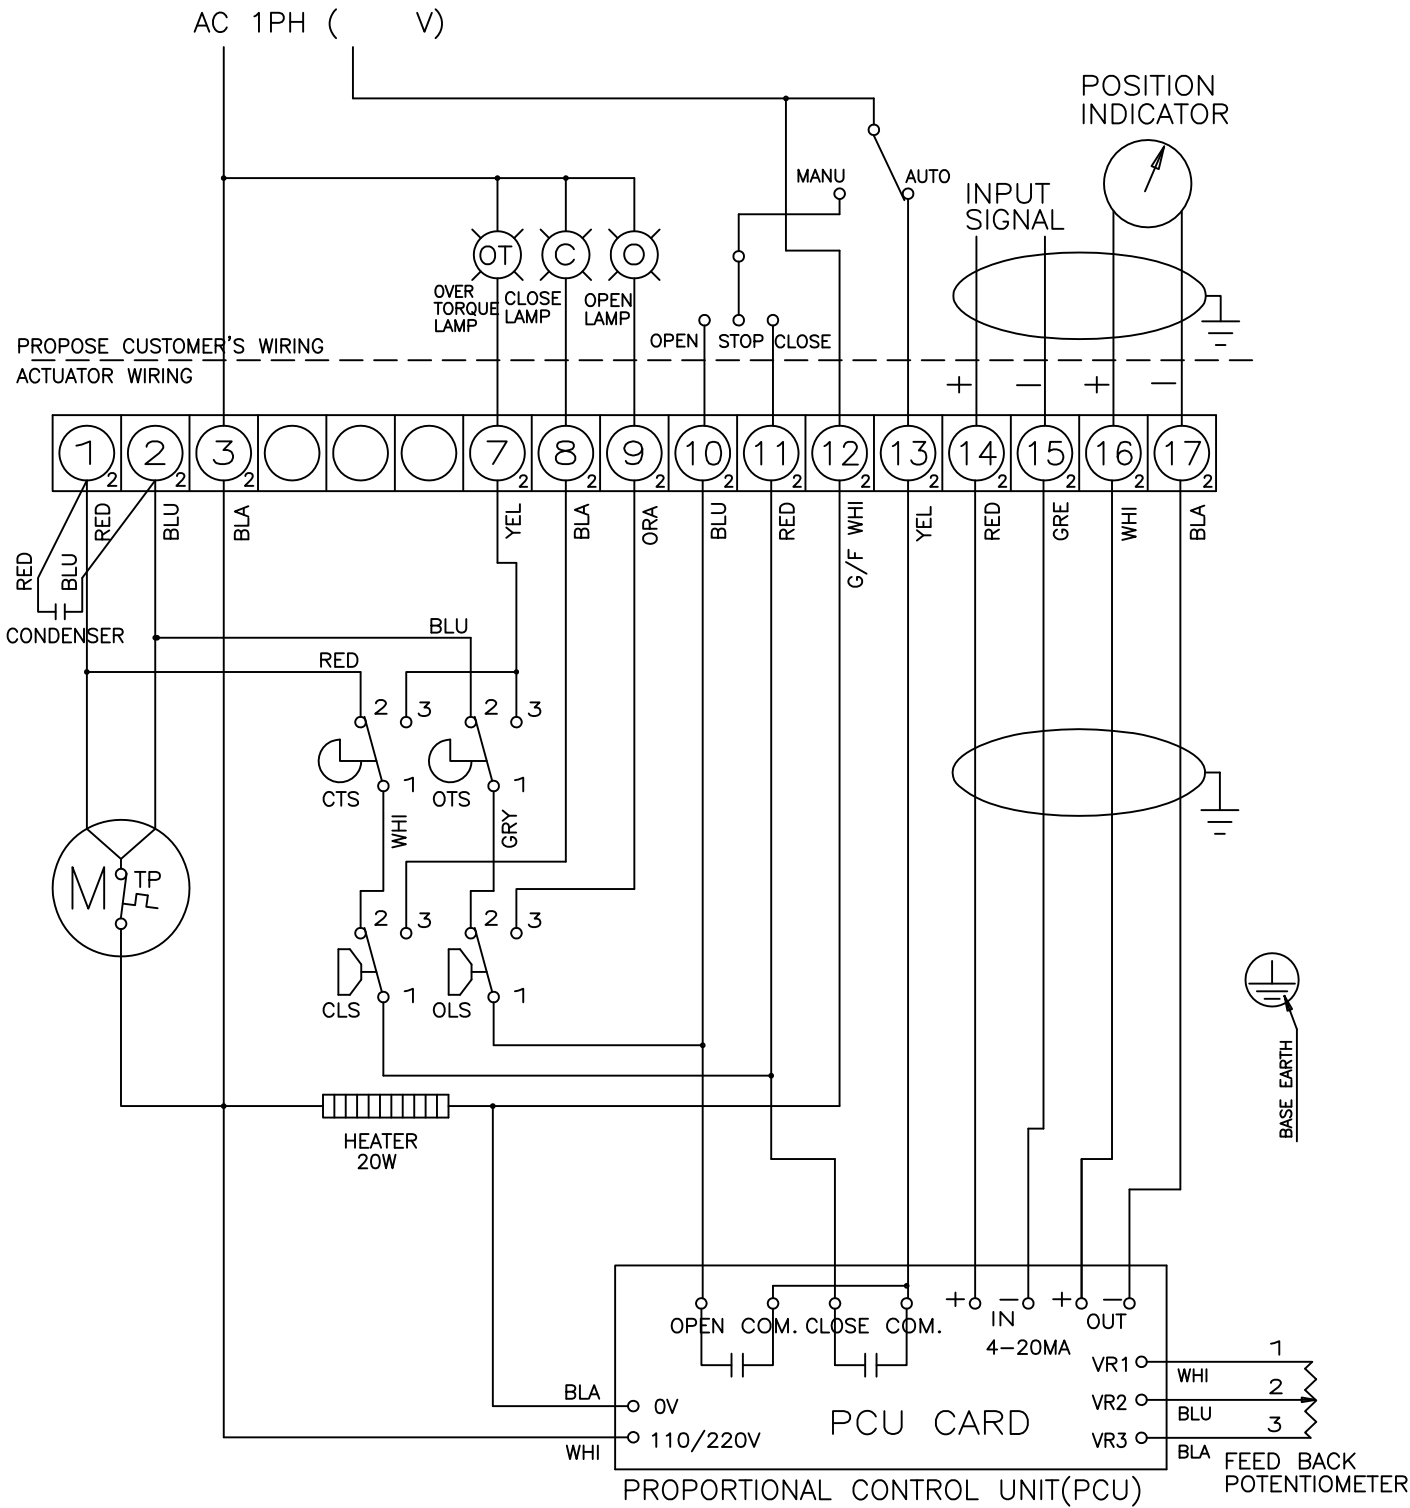

				△					
NL25	1			SYM	E C N NO	CHANGES	DATE	SIGN	APPD
NL20	1			DRAW	H,J KWON	PART NAME 1PH WIRING DIAGRAM PCU			
NL10	1			CHECK					
NL08	1			APPD					
APPLICATION				DATE	'17,06,12	DWG NO.	LS-15000-C		