


	CLOSE	OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

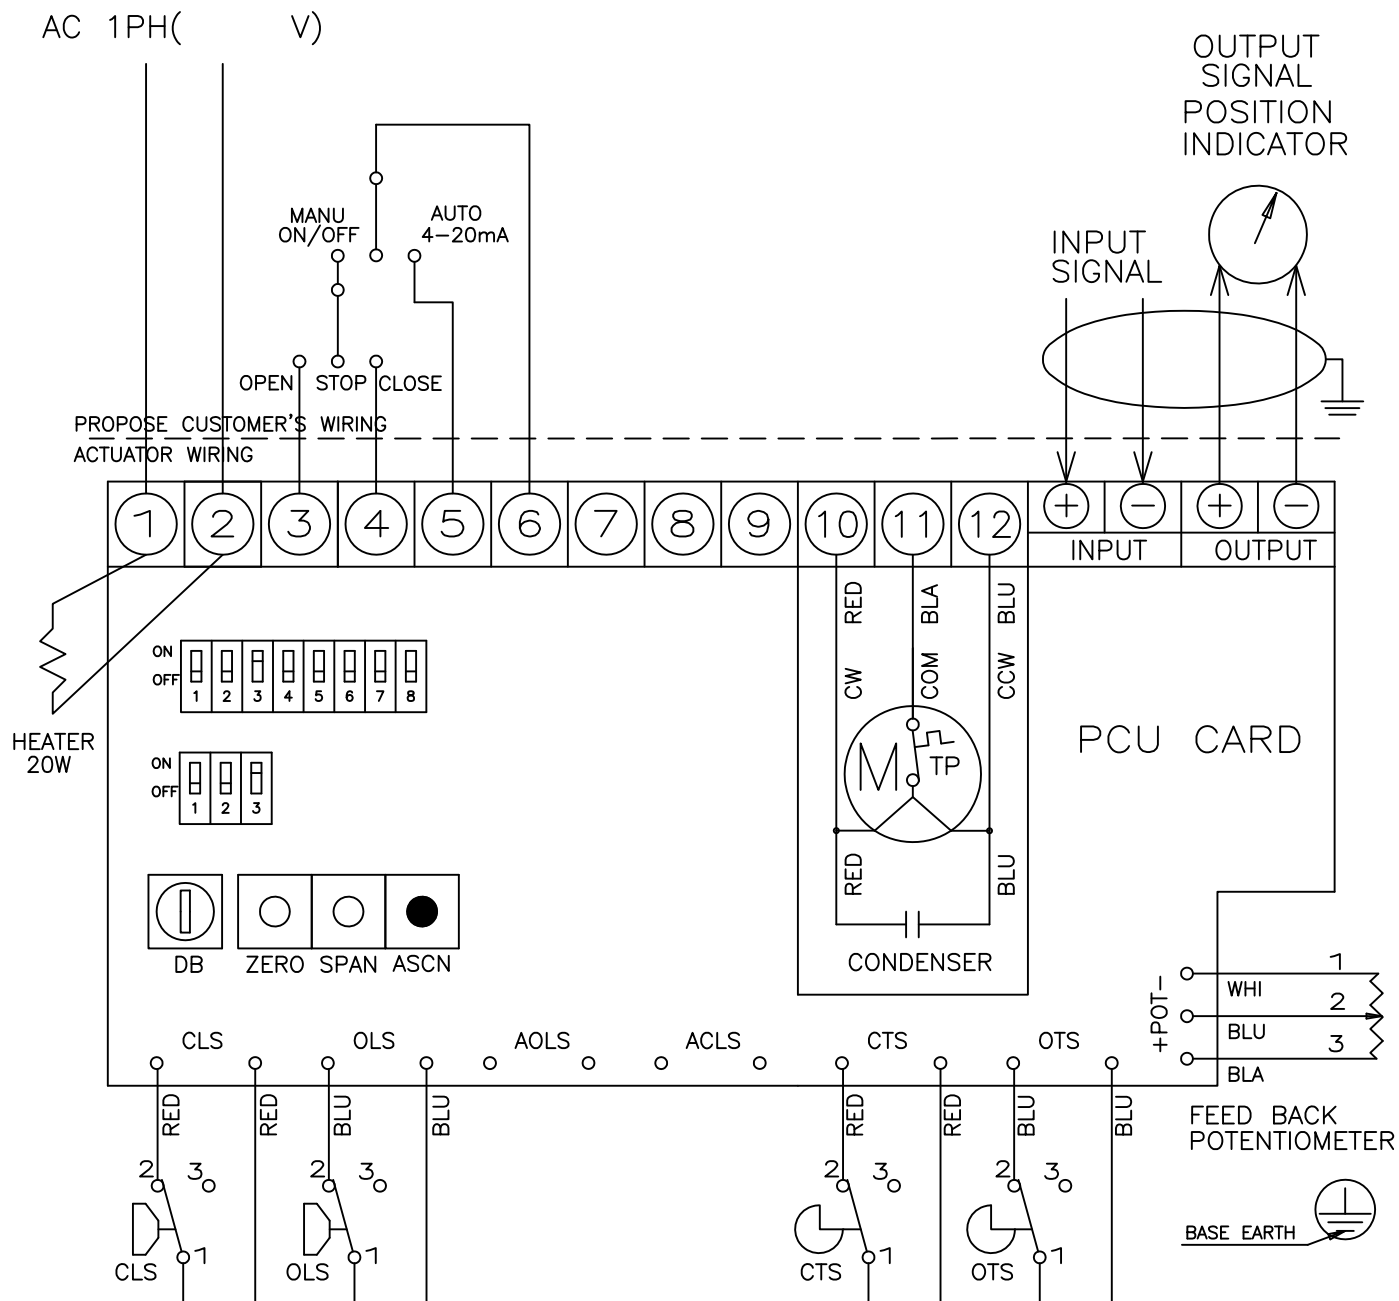

				△					
NL25	1			SYM	E C N NO	CHANGES	DATE	SIGN	APPD
NL20	1			DRAW	H,J KWON	PART NAME AC IPH WIRING DIAGRAM PCU			
NL10	1			CHECK					
NL08	1			APPD					
APPLICATION				DATE	'14,06,20	DWG NO.	LS-15E00-A		