


CLS : CLOSE LIMIT SWITCH (250VAC 6A)
 OLS : OPEN LIMIT SWITCH (250VAC 6A)
 CTS : CLOSE TORQUE SWITCH (250VAC 6A)
 OTS : OPEN TORQUE SWITCH (250VAC 6A)
 ACLS : AUX, CLOSE LIMIT SWITCH (250VAC 6A)
 AOLS : AUX, OPEN LIMIT SWITCH (250VAC 6A)

	CLOSE	OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

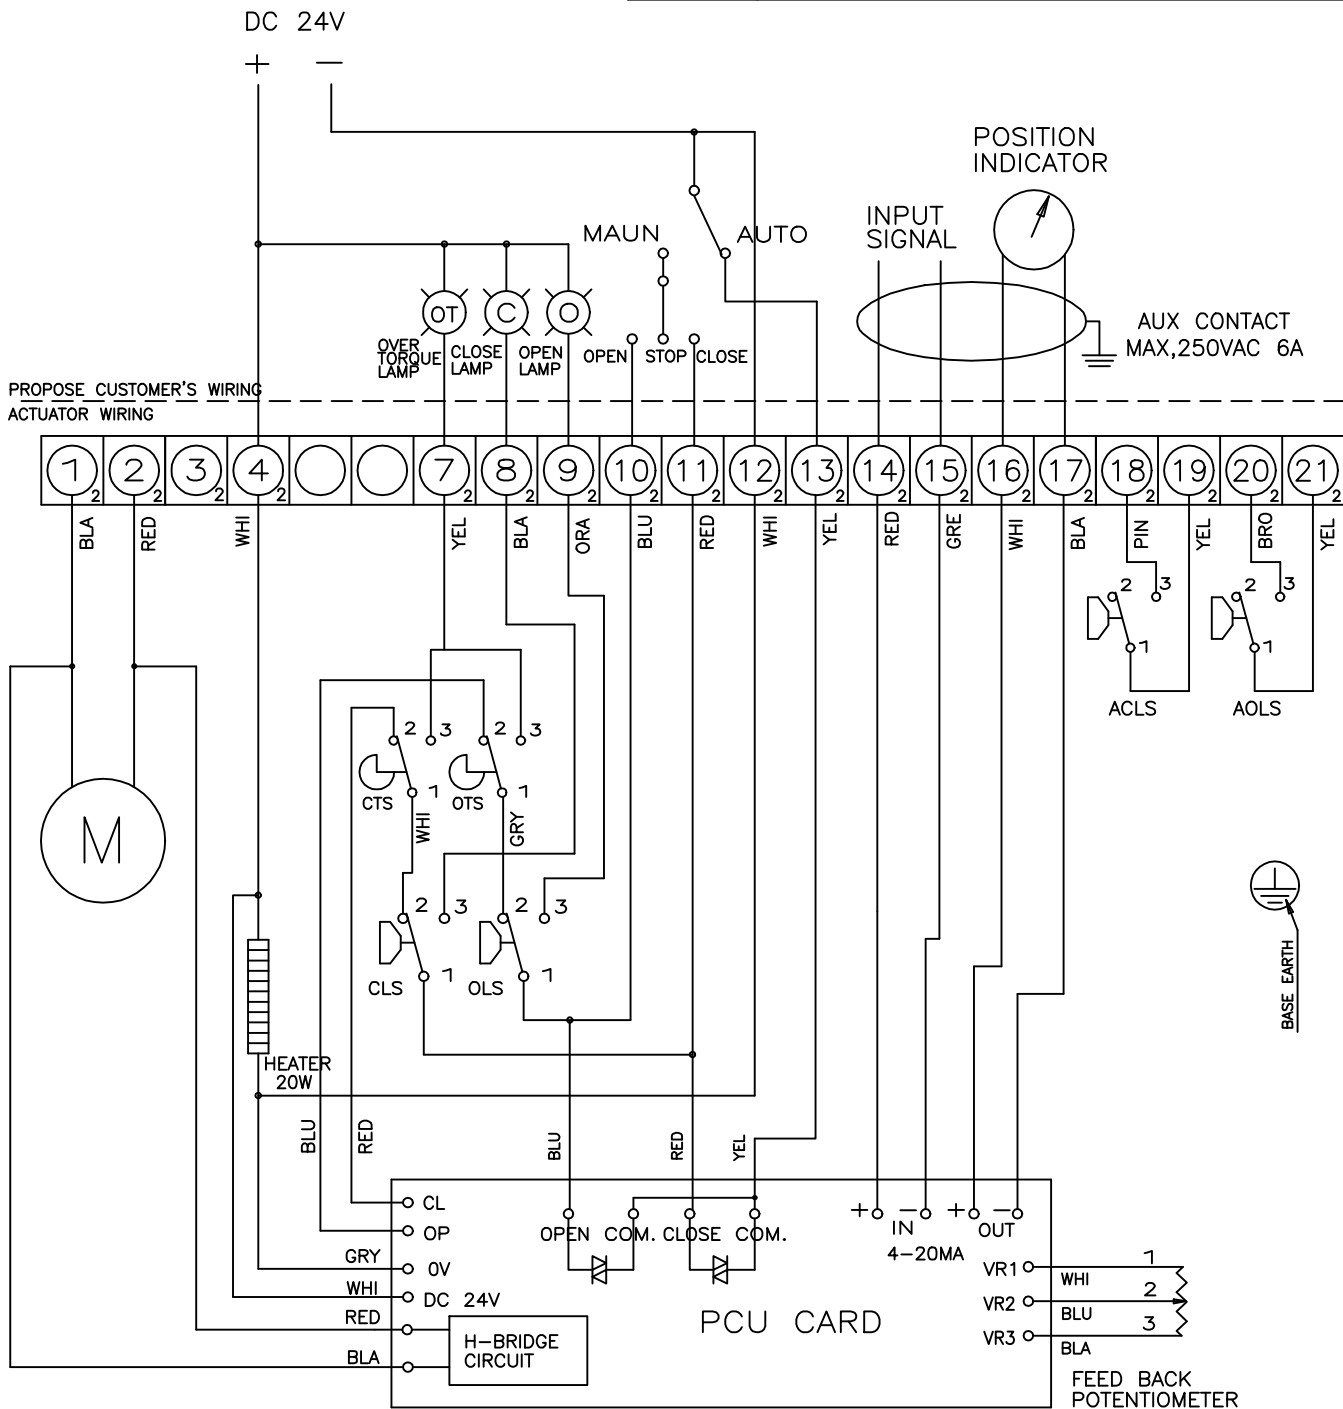

				△					
NL25	1			SYM	E C N NO	CHANGES	DATE	SIGN	APPD
NL20	1			DRAW	H,J KWON	PART NAME DC WIRING DIAGRAM PCU,ALS	DWG NO. LS-82500-F		
NL10	1			CHECK					
NL08	1			APPD					
APPLICATION				DATE	'16,02,26				