


CLS : CLOSE LIMIT SWITCH (250VAC 16A)
OLS : OPEN LIMIT SWITCH (250VAC 16A)
TP : THERMAL PROTECTOR (250VAC 15A)

	CLOSE	OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		

*EACH ACTUATOR SHOULD BE POWERED THROUGH ITS OWN INDIVIDUAL SWITCH OR RELAY CONTACTS TO PREVENT CROSS FEED BETWEEN TWO OR MORE ACTUATORS

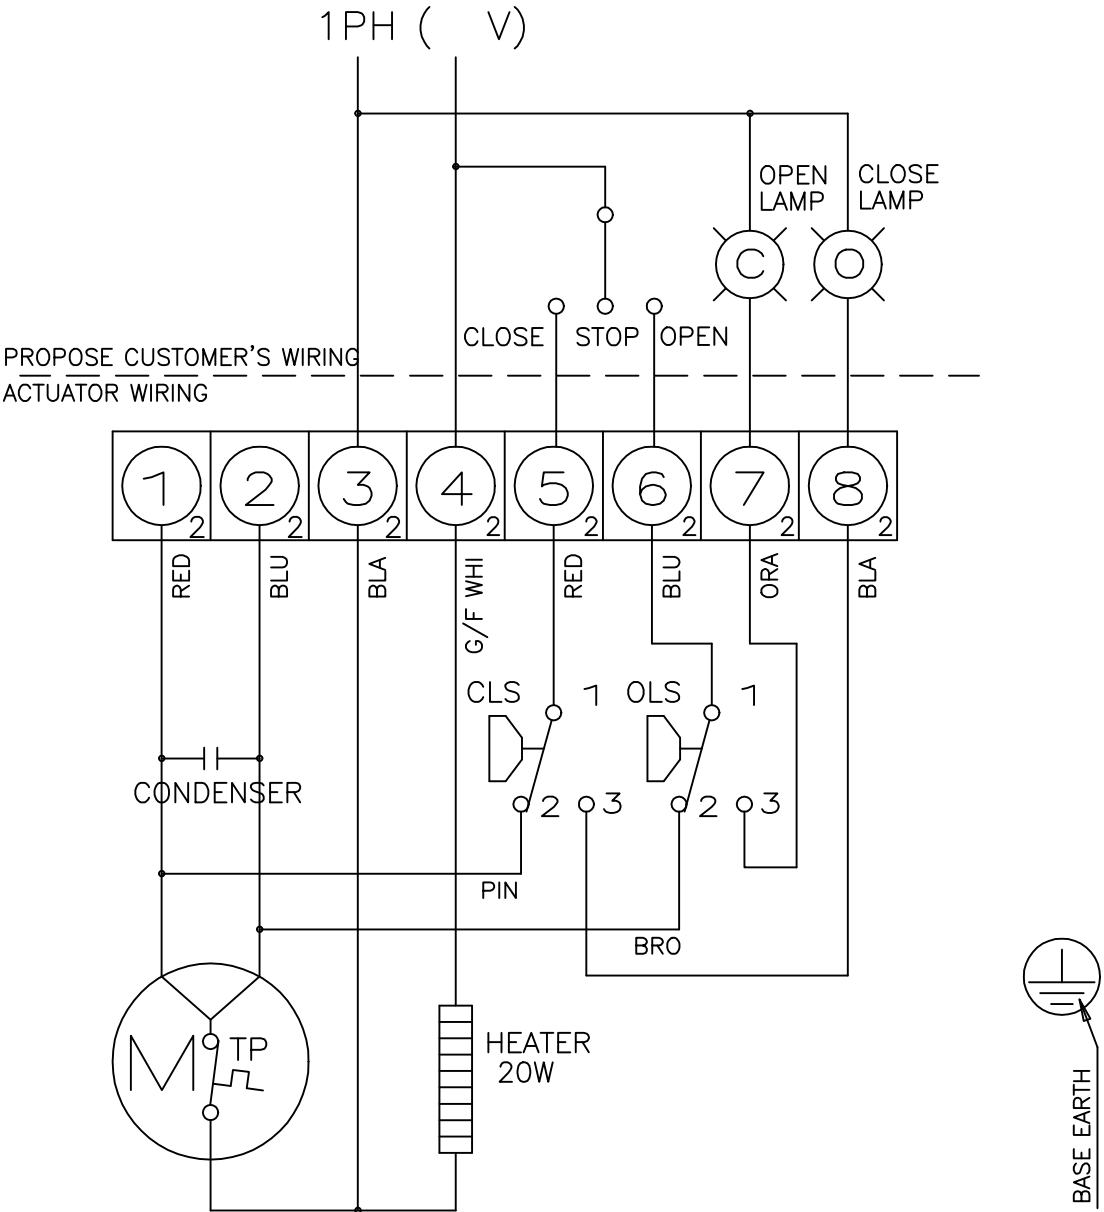

			△					
			SYM	E C N NO	CHANGES	DATE	SIGN	APPD
			DRAW	H,J KWON	PART NAME 1PH WIRING DIAGRAM			
NLO6	1		CHECK					
NLO4	1		APPD		DWG NO. LU-11000-C			
APPLICATION			DATE	'16,11,08				