


CLS : CLOSE LIMIT SWITCH (250VAC 15A)
 OLS : OPEN LIMIT SWITCH (250VAC 15A)
 CTS : CLOSE TORQUE SWITCH (250VAC 15A)
 OTS : OPEN TORQUE SWITCH (250VAC 15A)
 ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 5A)
 AOLS : AUX. OPEN LIMIT SWITCH (250VAC 5A)
 TP : THERMAL PROTECTOR (250VAC 15A)

CLOSE		OPEN	
CLS 1-2			
CLS 1-3			
OLS 1-2			
OLS 1-3			
ACLS			
AOLS			
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE		
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE		

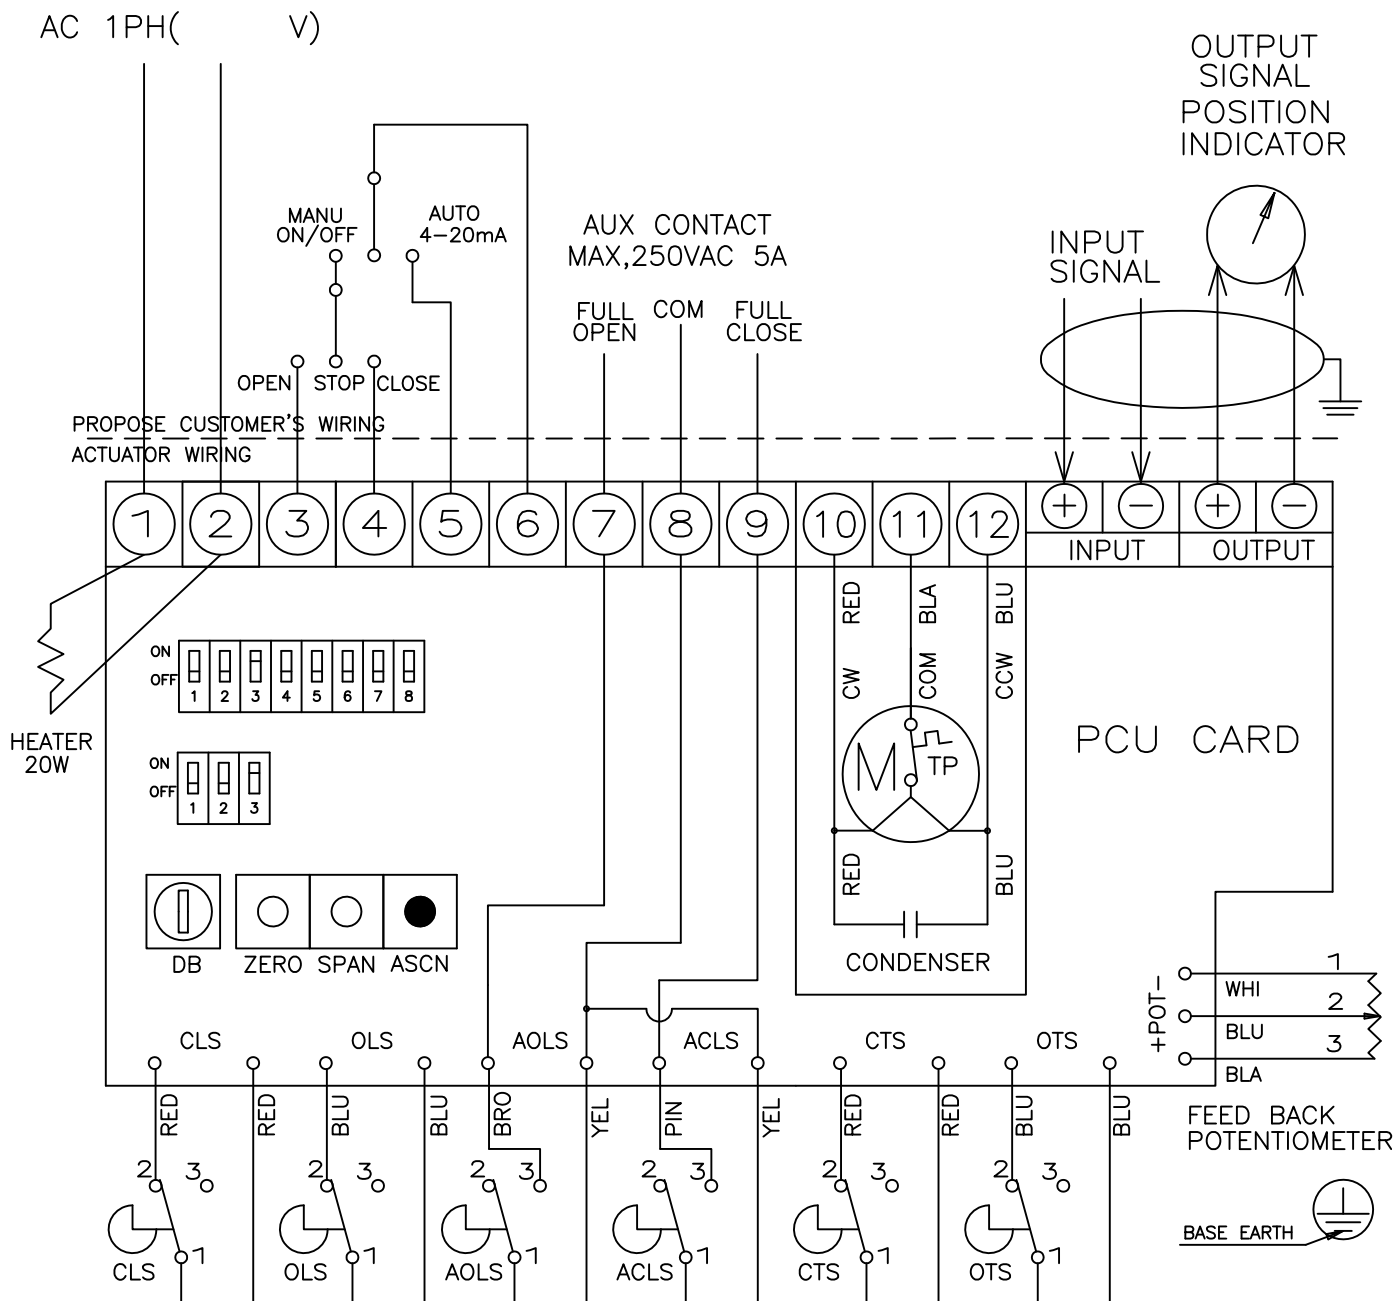

A050	1	A250	1	△					
A038	1	A200	1	SYM	E C N NO	CHANGES	DATE	SIGN	APPD
A028	1	A150	1	DRAW	H,J KWON	PART NAME AC IPH WIRING DIAGRAM ALS,PCU			
A019	1	A100	1	CHECK					
A015	1	A080	1	APPD					
APPLICATION	A060	1	DATE	'13.07,08	DWG NO.	NS-125EO-A			