


CLS : CLOSE LIMIT SWITCH (250VAC 15A)
 OLS : OPEN LIMIT SWITCH (250VAC 15A)
 CTS : CLOSE TORQUE SWITCH (250VAC 15A)
 OTS : OPEN TORQUE SWITCH (250VAC 15A)
 ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 15A)
 AOLS : AUX. OPEN LIMIT SWITCH (250VAC 15A)
 TP : THERMAL PROTECTOR (250VAC 15A)

	CLOSE	OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
ACLS 1-2		
ACLS 1-3		
AOLS 1-2		
AOLS 1-3		
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

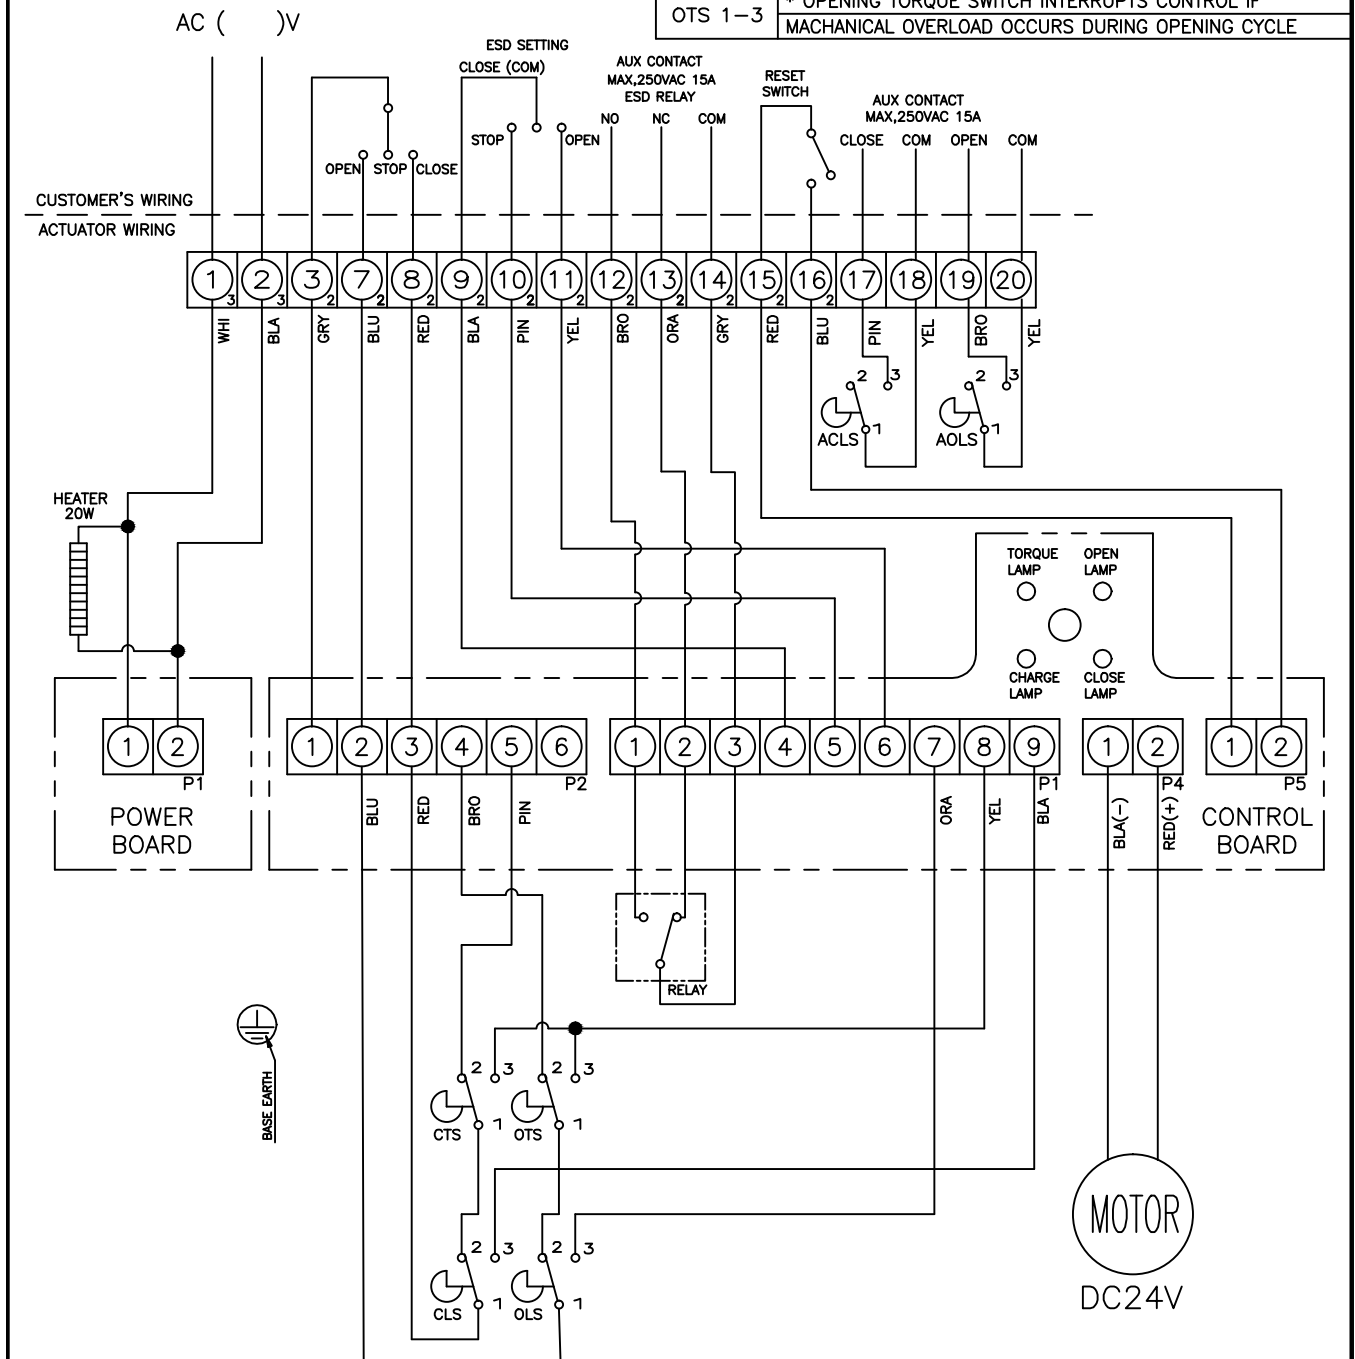

				△			
				SYM	E C N NO	CHANGES	DATE SIGN
				DRAW	H.J. KIM	PART NAME	1PH WIRING DIAGRAM ALS, SUPER CAP
A019	1			CHECK	K.H. OH		
A015	1			APPD			
APPLICATION				DATE	20.05.28.	DWG NO.	NS-126SO-B