


CLS : CLOSE LIMIT SWITCH (250VAC 16A)
OLS : OPEN LIMIT SWITCH (250VAC 16A)
CTS : CLOSE TORQUE SWITCH (250VAC 16A)
OTS : OPEN TORQUE SWITCH (250VAC 16A)
ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 16A)
AOLS : AUX. OPEN LIMIT SWITCH (250VAC 16A)
TP : THERMAL PROTECTOR (250VAC 16A)

CLOSE		OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
ACLS 1-2		
ACLS 1-3		
AOLS 1-2		
AOLS 1-3		
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

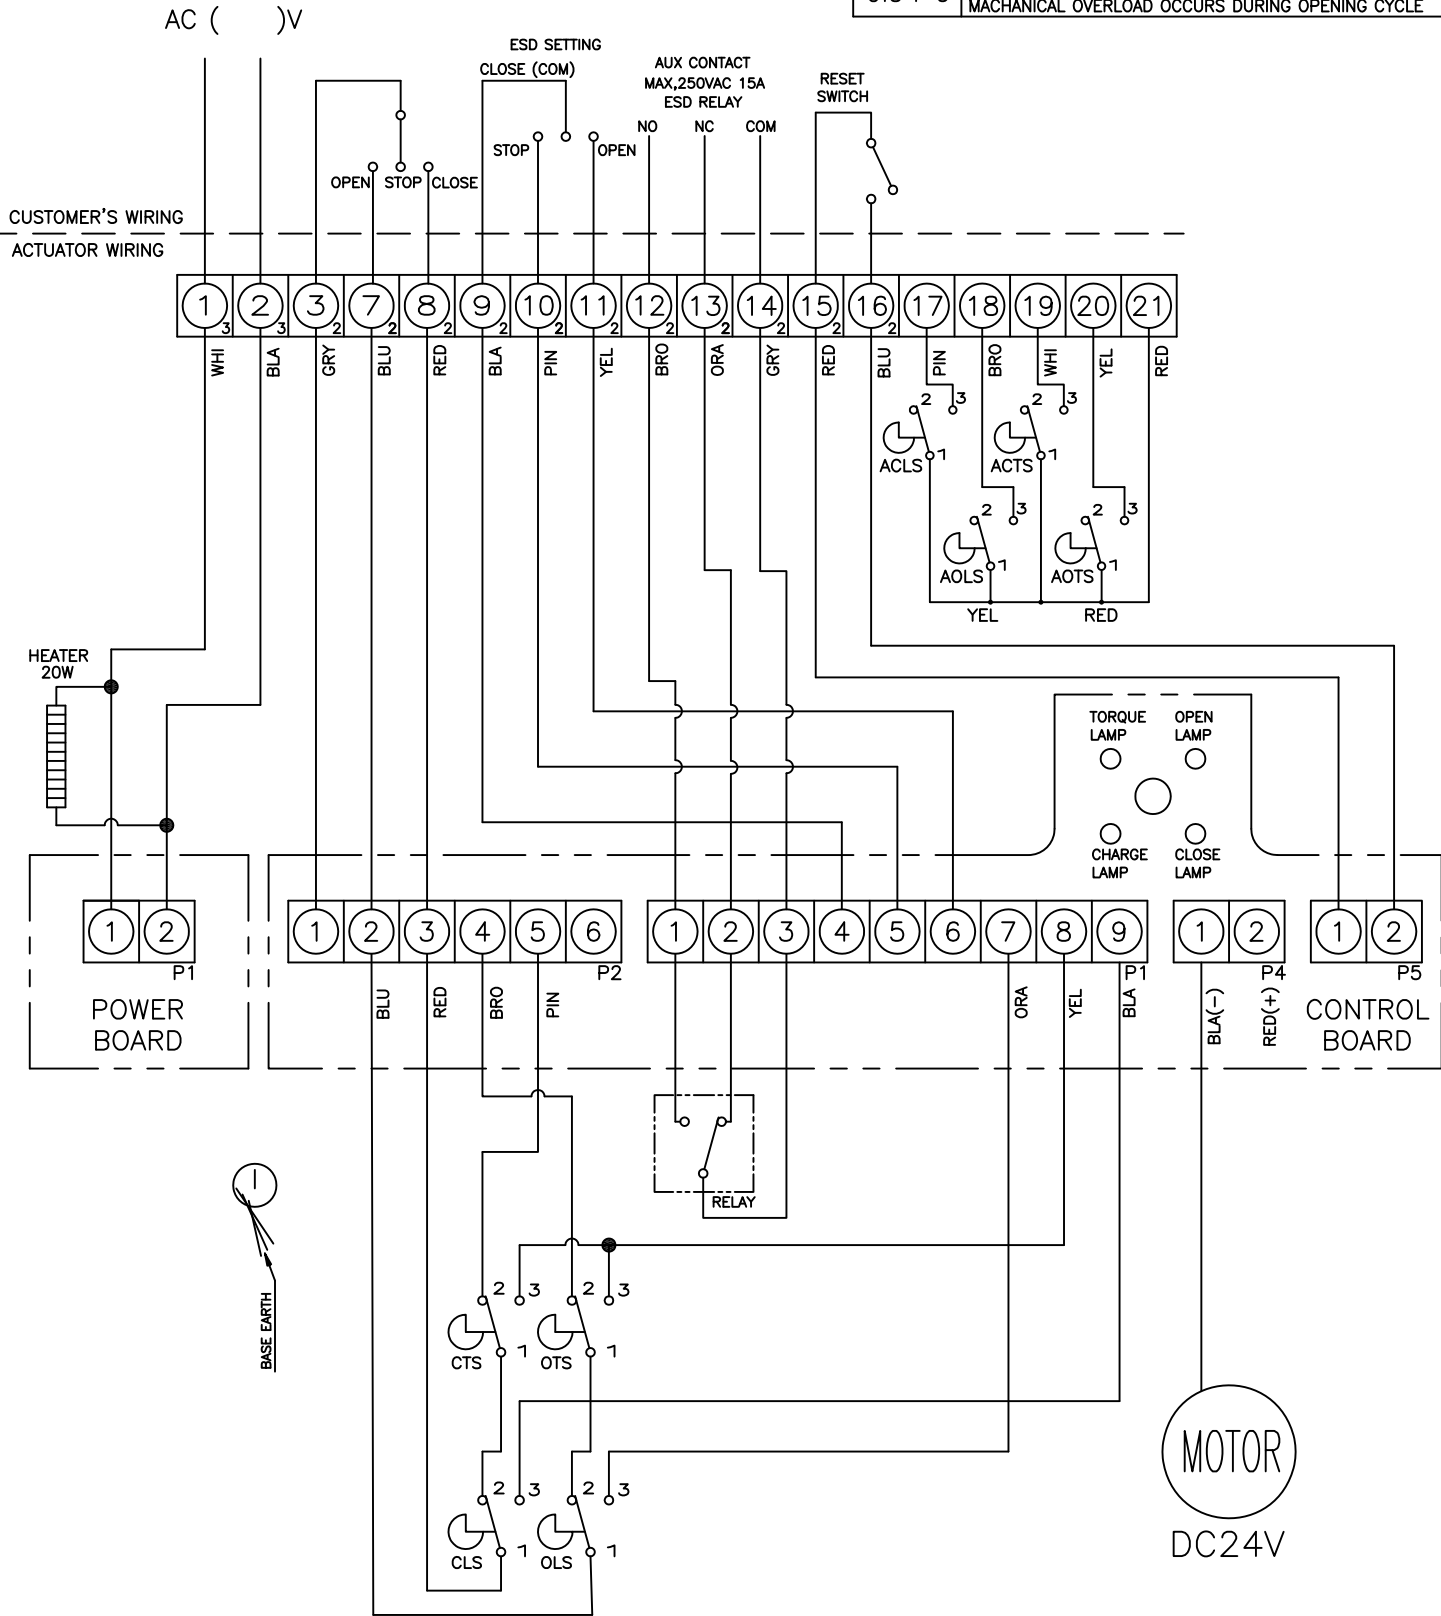

				△				
				SYM	E C N NO	CHANGES	DATE	SIGN
				DRAW	J.E BYEON	PART NAME 1PH WIRING DIAGRAM ALS, ATS, SUPER CAP		
A019	1			CHECK				
A015	1			APPD		DWG NO. NS-126S9-A		
APPLICATION				DATE	23.06.22			