


CLS : CLOSE LIMIT SWITCH (250VAC 15A)
 OLS : OPEN LIMIT SWITCH (250VAC 15A)
 CTS : CLOSE TORQUE SWITCH (250VAC 15A)
 OTS : OPEN TORQUE SWITCH (250VAC 15A)
 TP : THERMAL PROTECTOR (250VAC 15A)

CLOSE		OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

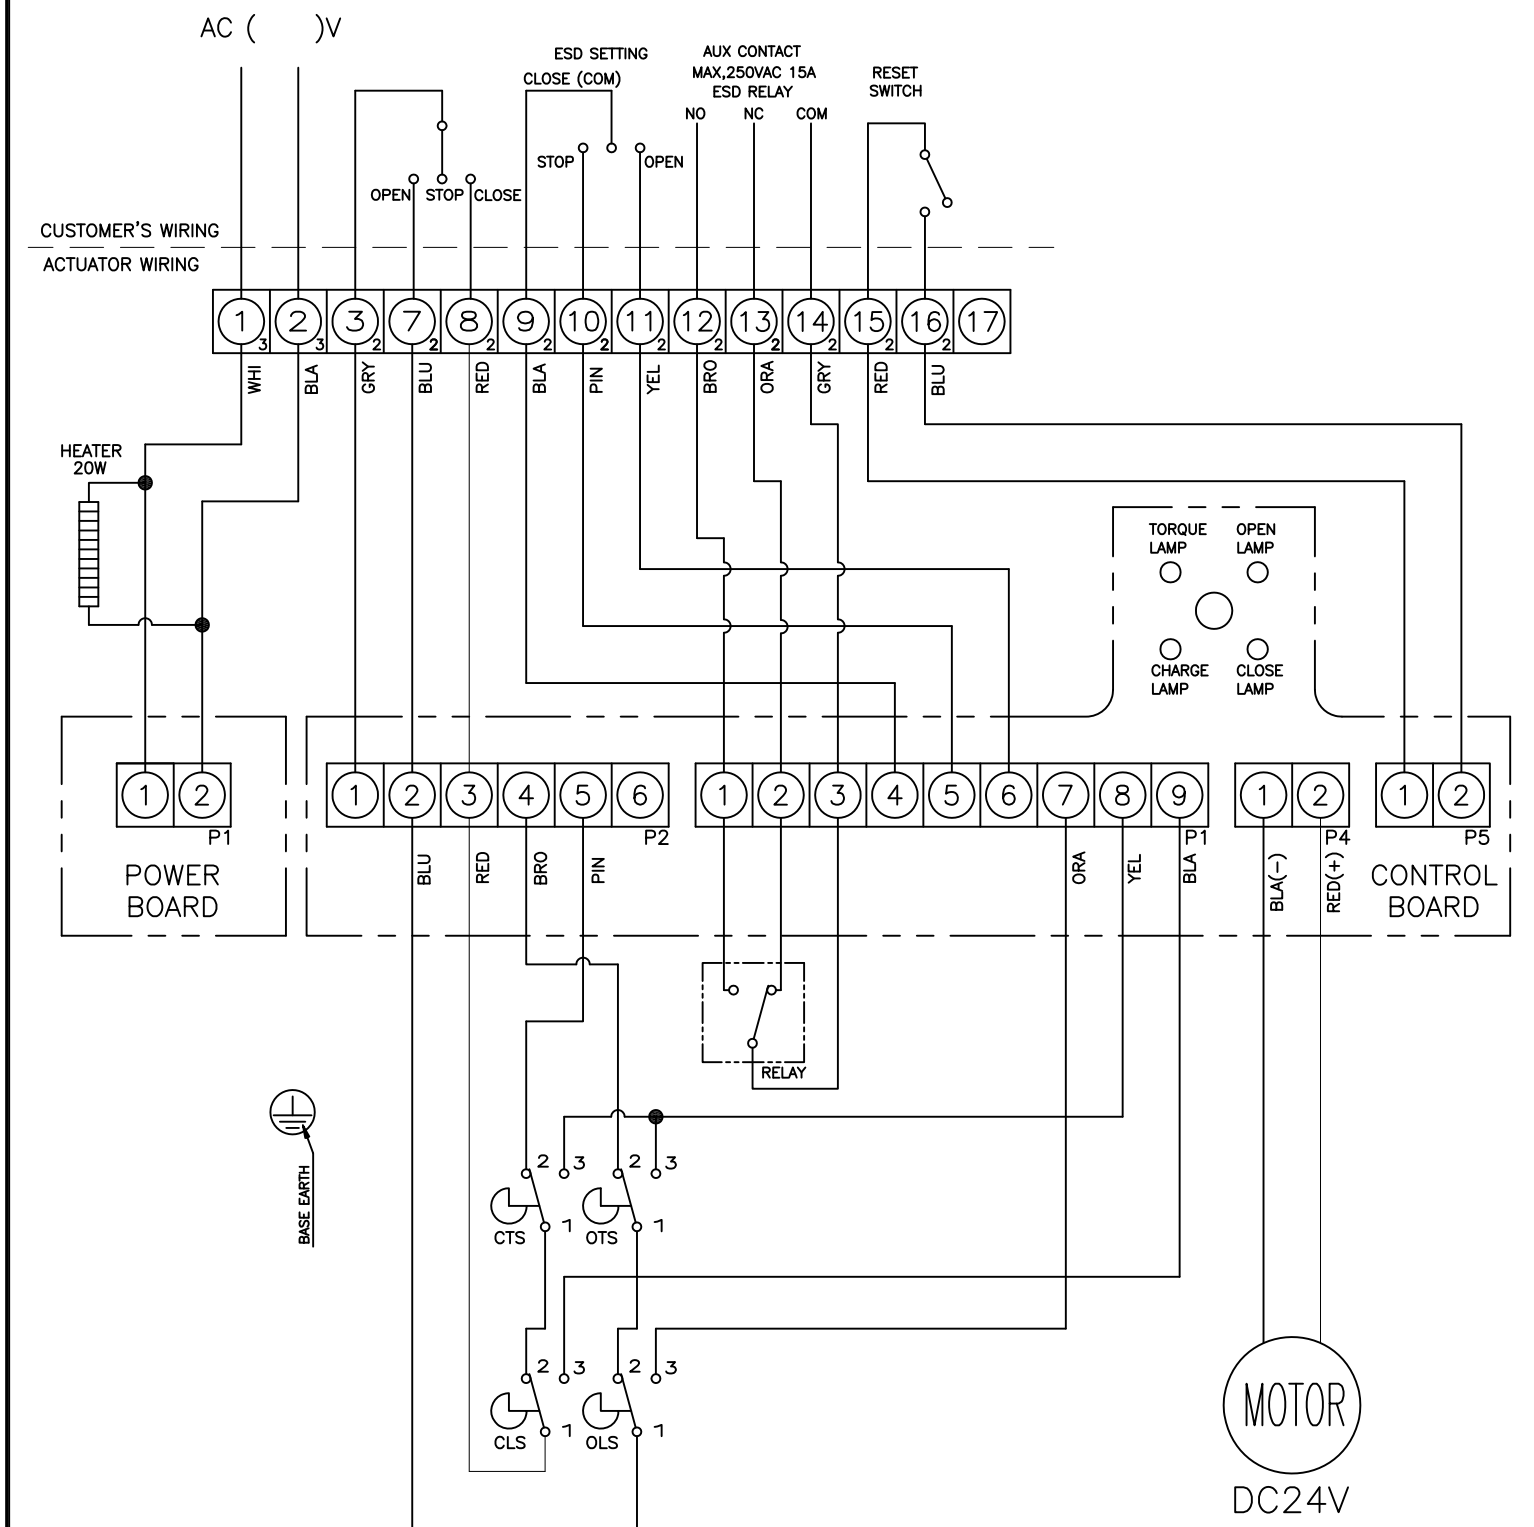

				△				
				SYM	E C N NO	CHANGES	DATE	SIGN
				DRAW	H.J. KIM	PART NAME 1PH WIRING DIAGRAM SUPER CAP		
A019	1			CHECK	K.H. OH			
A015	1			APPD		DWG NO. NS-16S00-B		
APPLICATION				DATE	20.05.28.			