


CLS : CLOSE LIMIT SWITCH (250VAC 15A)  
 OLS : OPEN LIMIT SWITCH (250VAC 15A)  
 CTS : CLOSE TORQUE SWITCH (250VAC 15A)  
 OTS : OPEN TORQUE SWITCH (250VAC 15A)

|         | CLOSE                                                                                         | OPEN |
|---------|-----------------------------------------------------------------------------------------------|------|
| CLS 1-2 |                                                                                               |      |
| CLS 1-3 |                                                                                               |      |
| OLS 1-2 |                                                                                               |      |
| OLS 1-3 |                                                                                               |      |
| CTS 1-3 | * CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE |      |
| OTS 1-3 | * OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE |      |

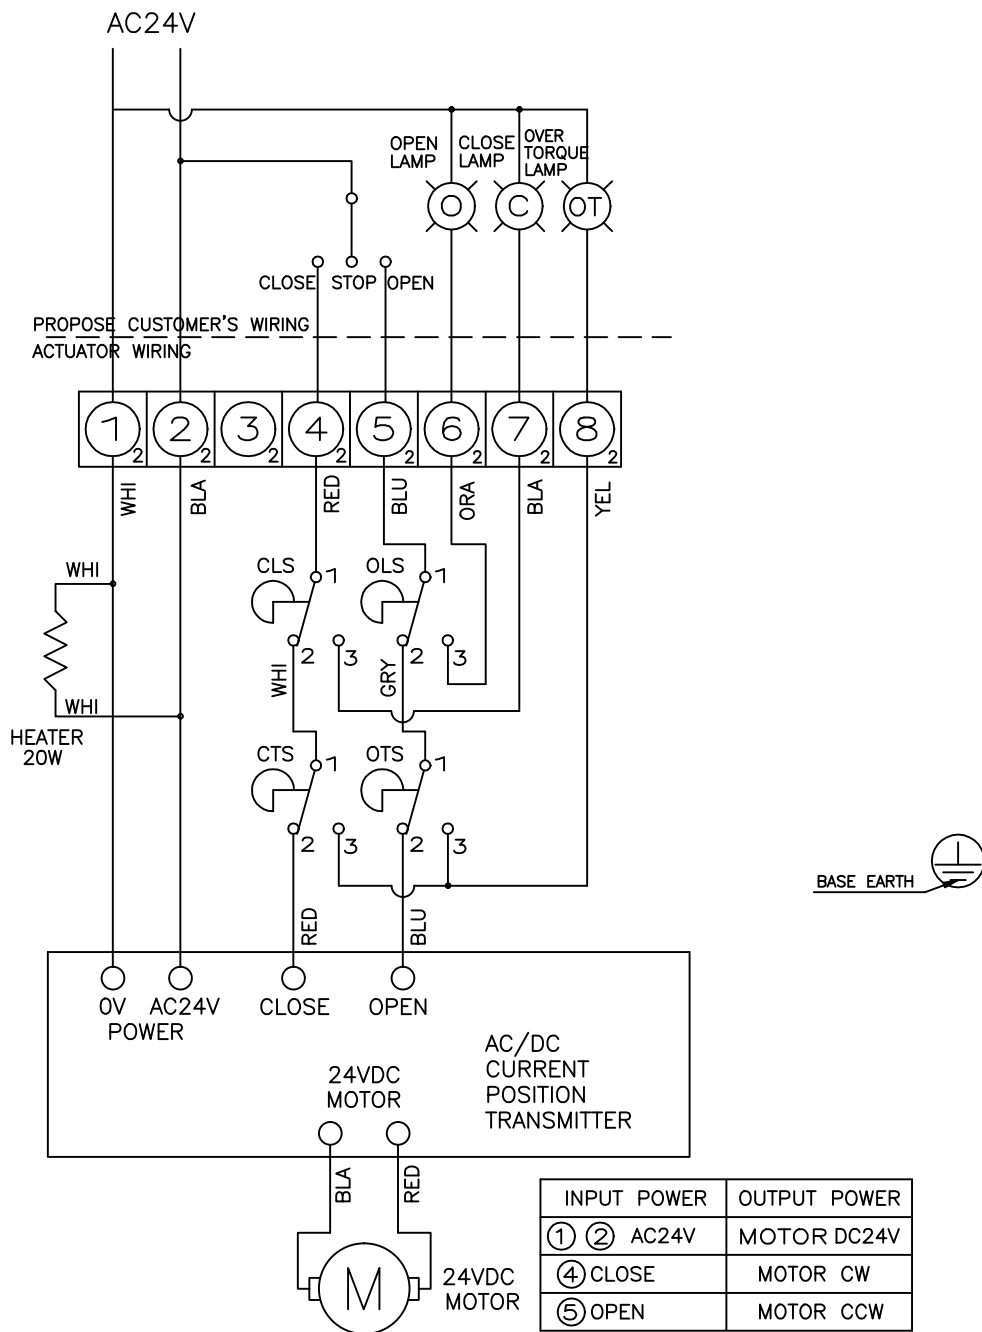

|             |  |  |  |       |           |                                |            |      |      |
|-------------|--|--|--|-------|-----------|--------------------------------|------------|------|------|
|             |  |  |  | △     |           |                                |            |      |      |
|             |  |  |  | SYM   | E C N NO  | CHANGES                        | DATE       | SIGN | APPD |
| A028        |  |  |  | DRAW  | H,J KWON  | PART NAME AC24V WIRING DIAGRAM |            |      |      |
| A019        |  |  |  | CHECK |           |                                |            |      |      |
| A015        |  |  |  | APPD  |           |                                |            |      |      |
| APPLICATION |  |  |  | DATE  | '09.01.19 | DWG NO.                        | NS-71000-D |      |      |