


CLS : CLOSE LIMIT SWITCH (250VAC 15A)
OLS : OPEN LIMIT SWITCH (250VAC 15A)
CTS : CLOSE TORQUE SWITCH (250VAC 15A)
OTS : OPEN TORQUE SWITCH (250VAC 15A)
ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 15A)
AOLS : AUX.OPEN LIMIT SWITCH (250VAC 15A)

CLOSE		OPEN	
CLS 1-2			
CLS 1-3			
OLS 1-2			
OLS 1-3			
ACLS 1-2			
ACLS 1-3			
AOLS 1-2			
AOLS 1-3			
* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE			
* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE			

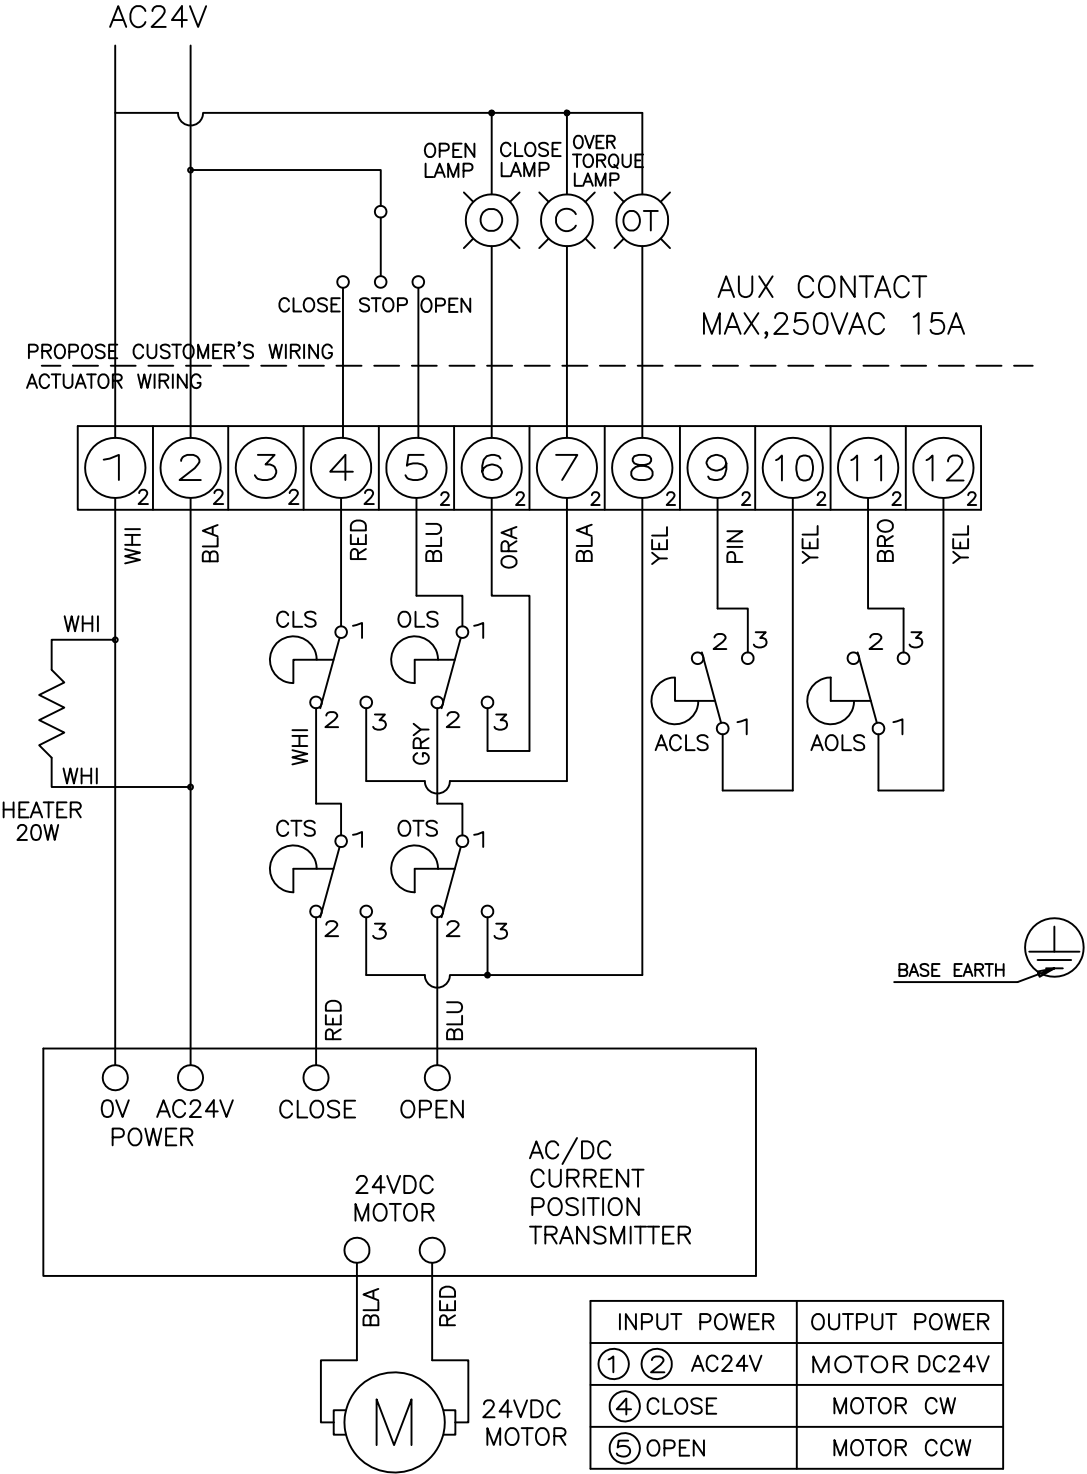

				△				
				SYM	E C N NO	CHANGES	DATE	SIGN APPD
A028				DRAW	H,J KWON	PART NAME AC24V WIRING DIAGRAM ALS		
A019				CHECK				
A015				APPD				
APPLICATION				DATE	'09.01.19	DWG NO.	NS-72000-D	