


CLS : CLOSE LIMIT SWITCH (250VAC 6A)
 OLS : OPEN LIMIT SWITCH (250VAC 6A)
 CTS : CLOSE TORQUE SWITCH (250VAC 6A)
 OTS : OPEN TORQUE SWITCH (250VAC 6A)
 ACLS : AUX, CLOSE LIMIT SWITCH (250VAC 6A)
 AOLS : AUX, OPEN LIMIT SWITCH (250VAC 6A)

CLOSE		OPEN	
CLS 1-2			
CLS 1-3			
OLS 1-2			
OLS 1-3			
ACLS 1-2			
ACLS 1-3			
AOLS 1-2			
AOLS 1-3			
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE		
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE		

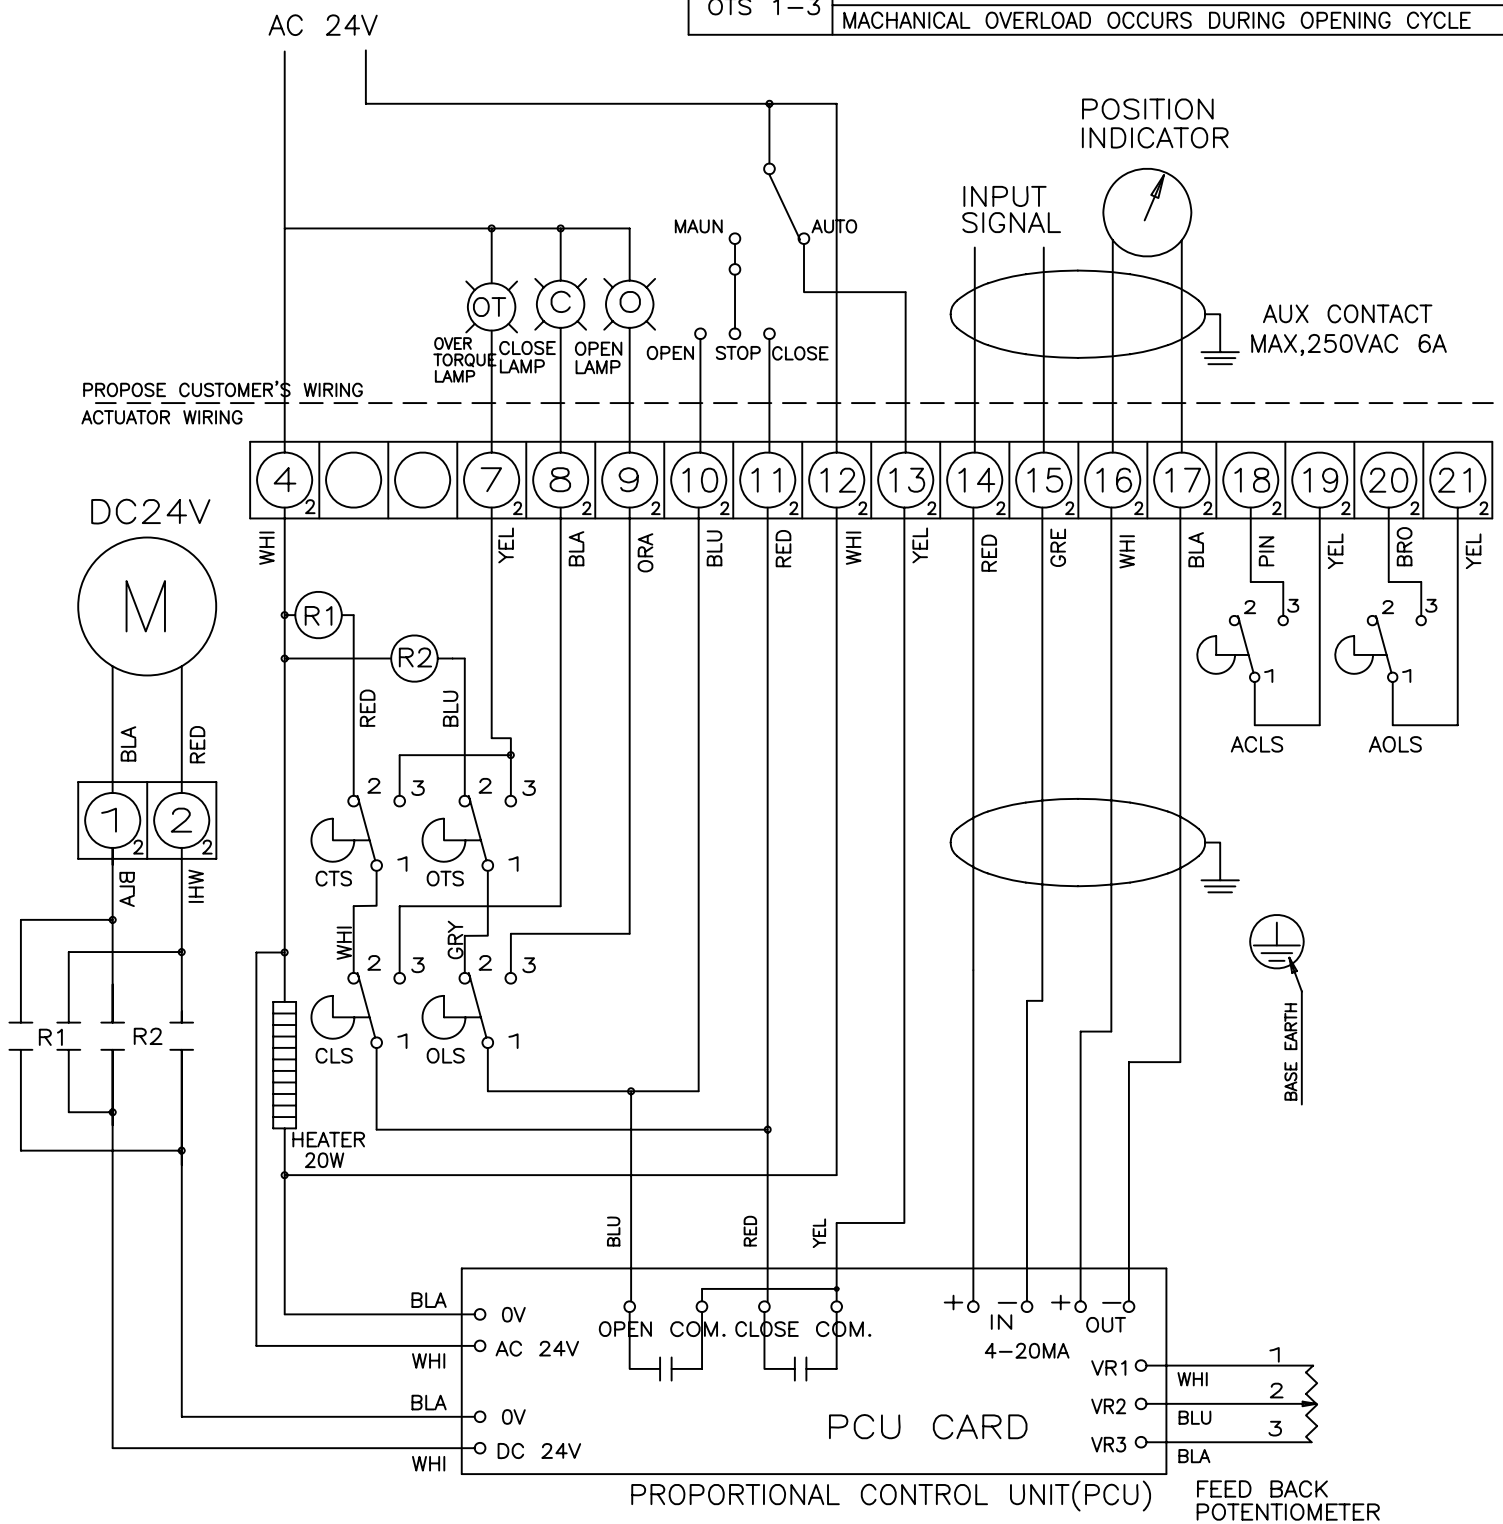

				△					
				SYM	E C N NO	CHANGES	DATE	SIGN	APPD
AO28	1			DRAW	H,J KWON	PART NAME AC24V WIRING DIAGRAM ALS,PCU			
AO19	1			CHECK					
AO15	1			APPD					
APPLICATION				DATE	'09.01.19	DWG NO.	NS-72500-C		