


CLS : CLOSE LIMIT SWITCH (250VAC 16A)
OLS : OPEN LIMIT SWITCH (250VAC 16A)
CTS : CLOSE TORQUE SWITCH (250VAC 16A)
OTS : OPEN TORQUE SWITCH (250VAC 16A)

CLOSE		OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

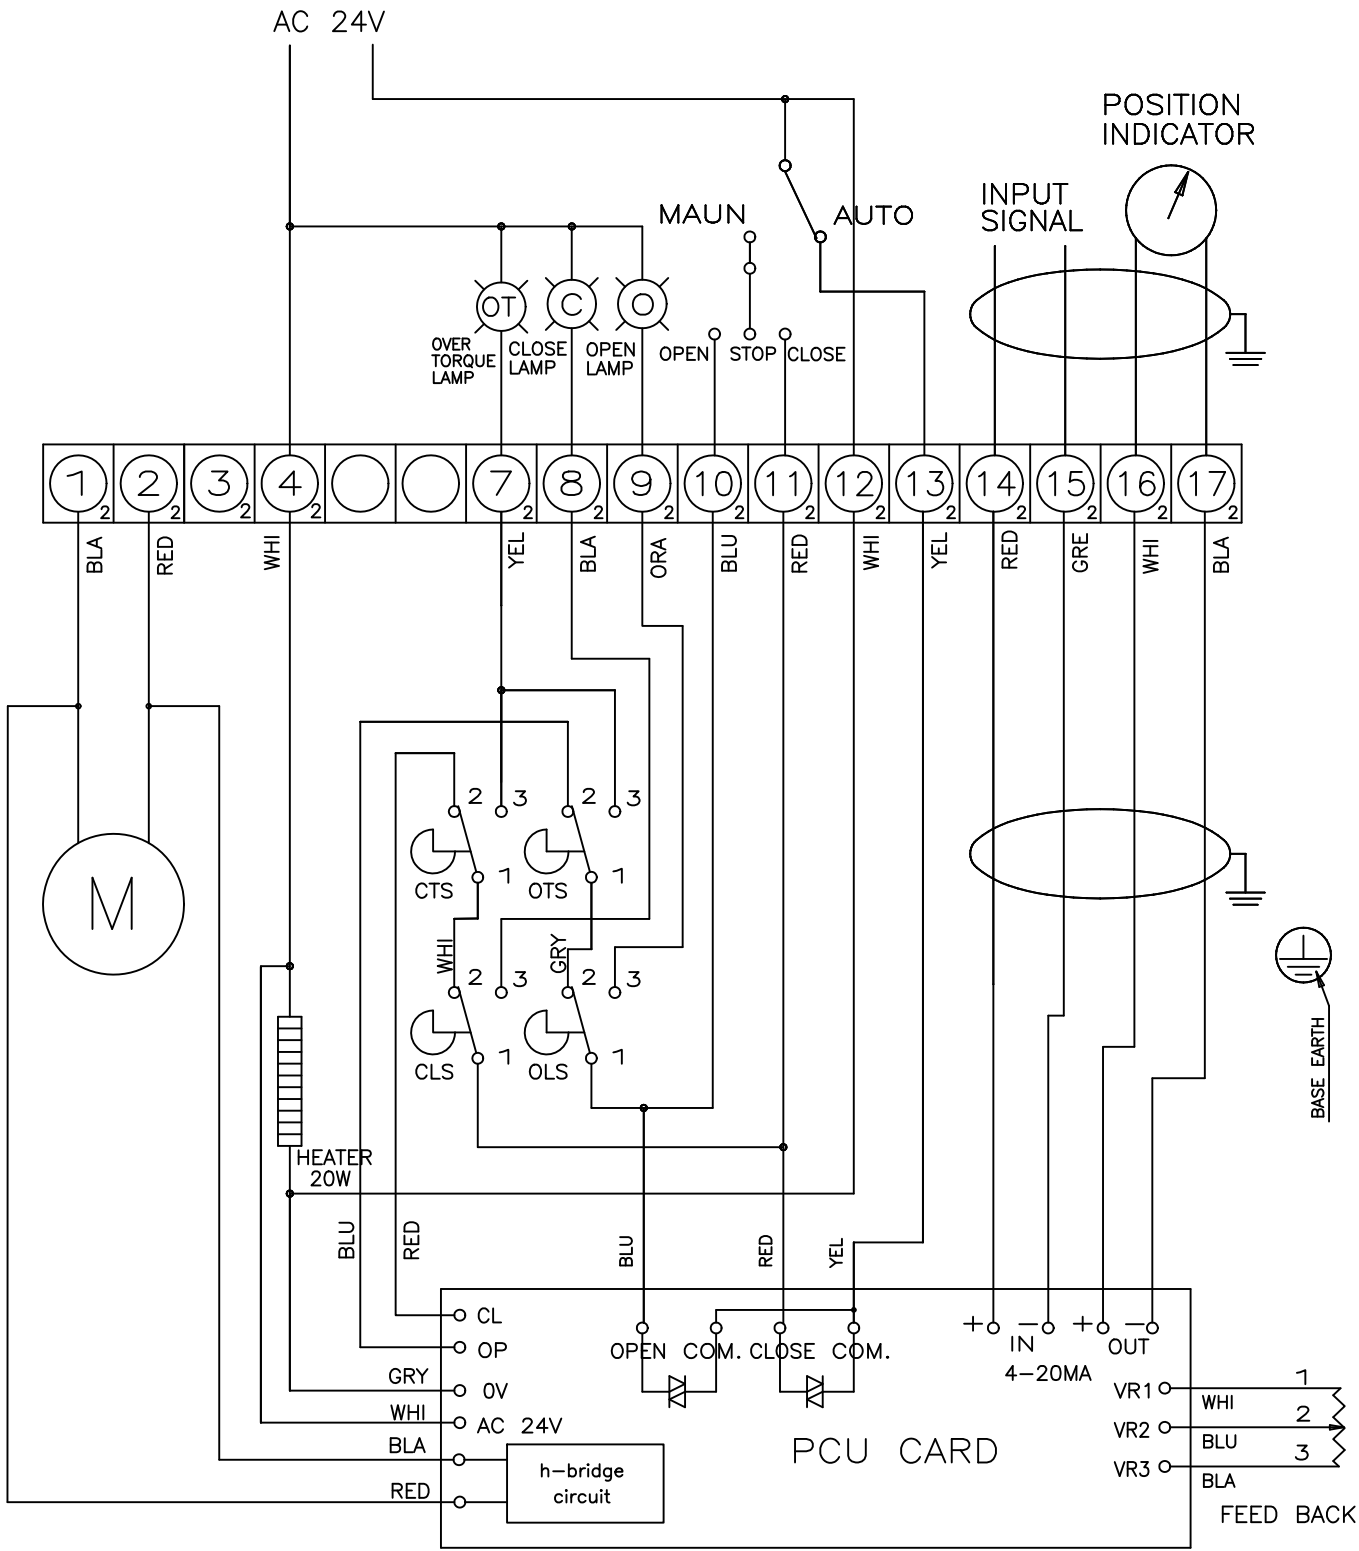

NO19	1	NO80	1	△					
NO15	1	NO60	1	SYM	E C N NO	CHANGES	DATE	SIGN	APPD
AO28	1	NO50	1	DRAW	J.E BYEON	PART NAME AC24V WIRING DIAGRAM PCU			
AO19	1	NO38	1	CHECK					
AO15	1	NO28	1	APPD		DWG NO. NS-75000-A			
APPLICATION				DATE	24.07.04				