


CLS : CLOSE LIMIT SWITCH (250VAC 16A)
 OLS : OPEN LIMIT SWITCH (250VAC 16A)
 CTS : CLOSE TORQUE SWITCH (250VAC 16A)
 OTS : OPEN TORQUE SWITCH (250VAC 16A)
 ACLS : AUX, CLOSE LIMIT SWITCH (250VAC 16A)
 AOLS : AUX, OPEN LIMIT SWITCH (250VAC 16A)

	CLOSE	OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
CTS 1-3	* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE	
OTS 1-3	* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE	

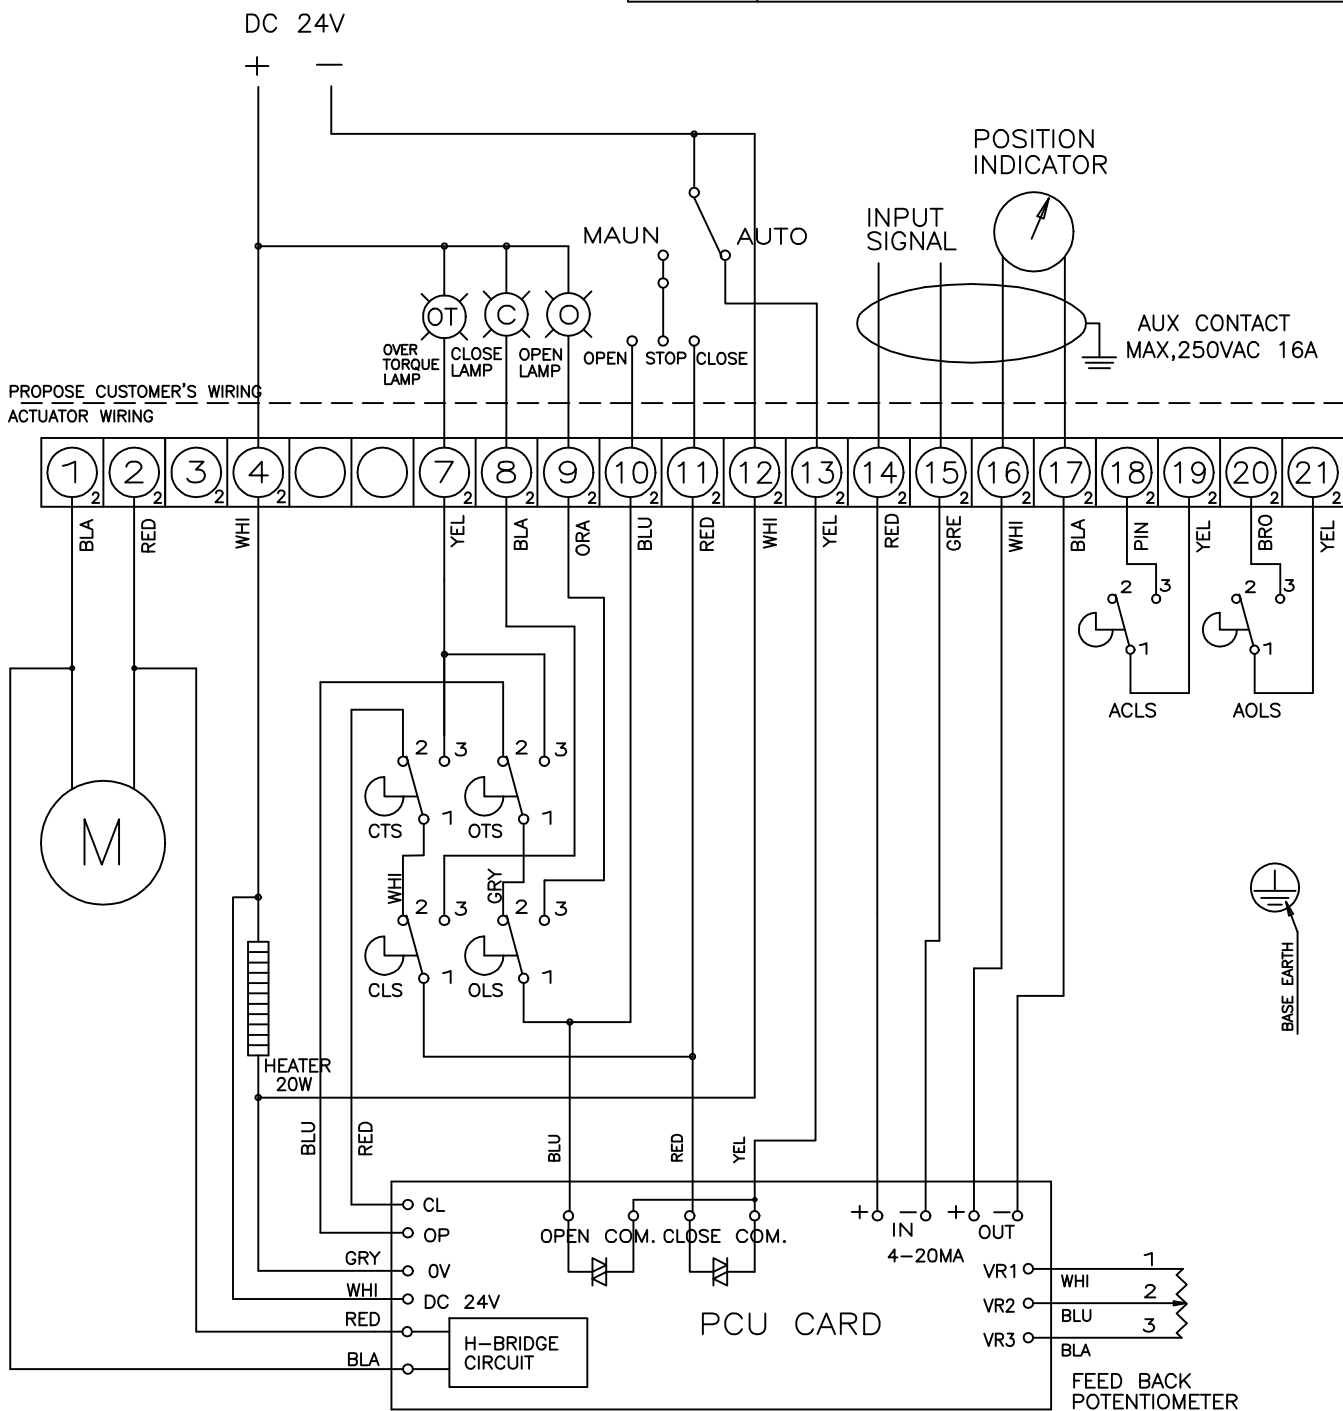

				△					
				SYM	E C N NO	CHANGES	DATE	SIGN	APPD
AO28	1			DRAW	H,J KWON	PART NAME DC WIRING DIAGRAM PCU,ALS			
AO19	1			CHECK					
AO15	1			APPD					
APPLICATION				DATE	'18,10,02	DWG NO.	NS-82500-F		