


CLS : CLOSE LIMIT SWITCH (250VAC 15A)
 OLS : OPEN LIMIT SWITCH (250VAC 15A)
 CTS : CLOSE TORQUE SWITCH (250VAC 15A)
 OTS : OPEN TORQUE SWITCH (250VAC 15A)
 ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 5A)
 AOLS : AUX. OPEN LIMIT SWITCH (250VAC 5A)
 TP : THERMAL PROTECTOR (250VAC 15A)

CLOSE		OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
ACLS		
ACLS		
* CLOSING TORQUE SWITCH INTERRUPTS CONTROL IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE		
* OPENING TORQUE SWITCH INTERRUPTS CONTROL IF MACHANICAL OVERLOAD OCCURS DURING OPENING CYCLE		

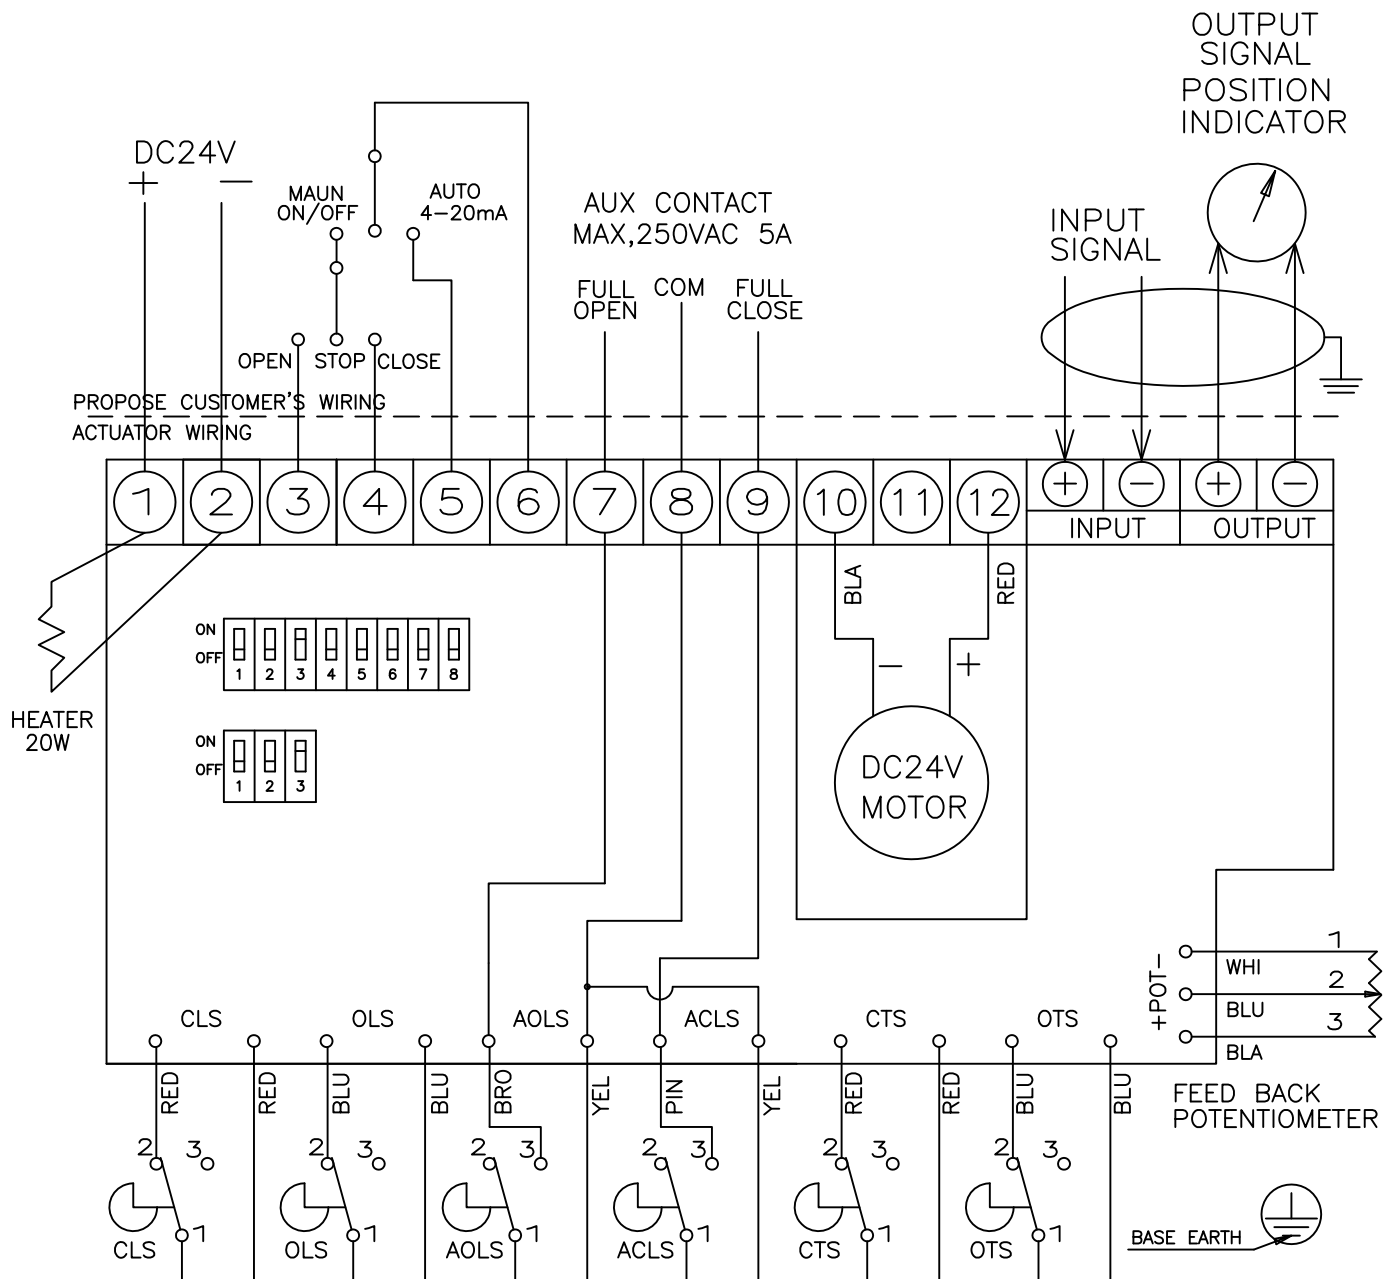

				△					
				SYM	E C N NO	CHANGES	DATE	SIGN	APPD
A028	1			DRAW	H,J KWON	PART NAME DC WIRING DIAGRAM ALS,PCU	DWG NO. NS-825EO-A		
A019	1			CHECK					
A015	1			APPD					
APPLICATION				DATE	'13,07,08				