


CLS : CLOSE LIMIT SWITCH (250VAC 16A)
 OLS : OPEN LIMIT SWITCH (250VAC 16A)
 ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 16A)
 AOLS : AUX. OPEN LIMIT SWITCH (250VAC 16A)

	CLOSE	OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
ACLS 1-2		
ACLS 1-3		
AOLS 1-2		
AOLS 1-3		

*EACH ACTUATOR SHOULD BE POWERED THROUGH ITS OWN INDIVIDUAL SWITCH OR RELAY CONTACTS TO PREVENT CROSS FEED BETWEEN TWO OR MORE ACTUATORS

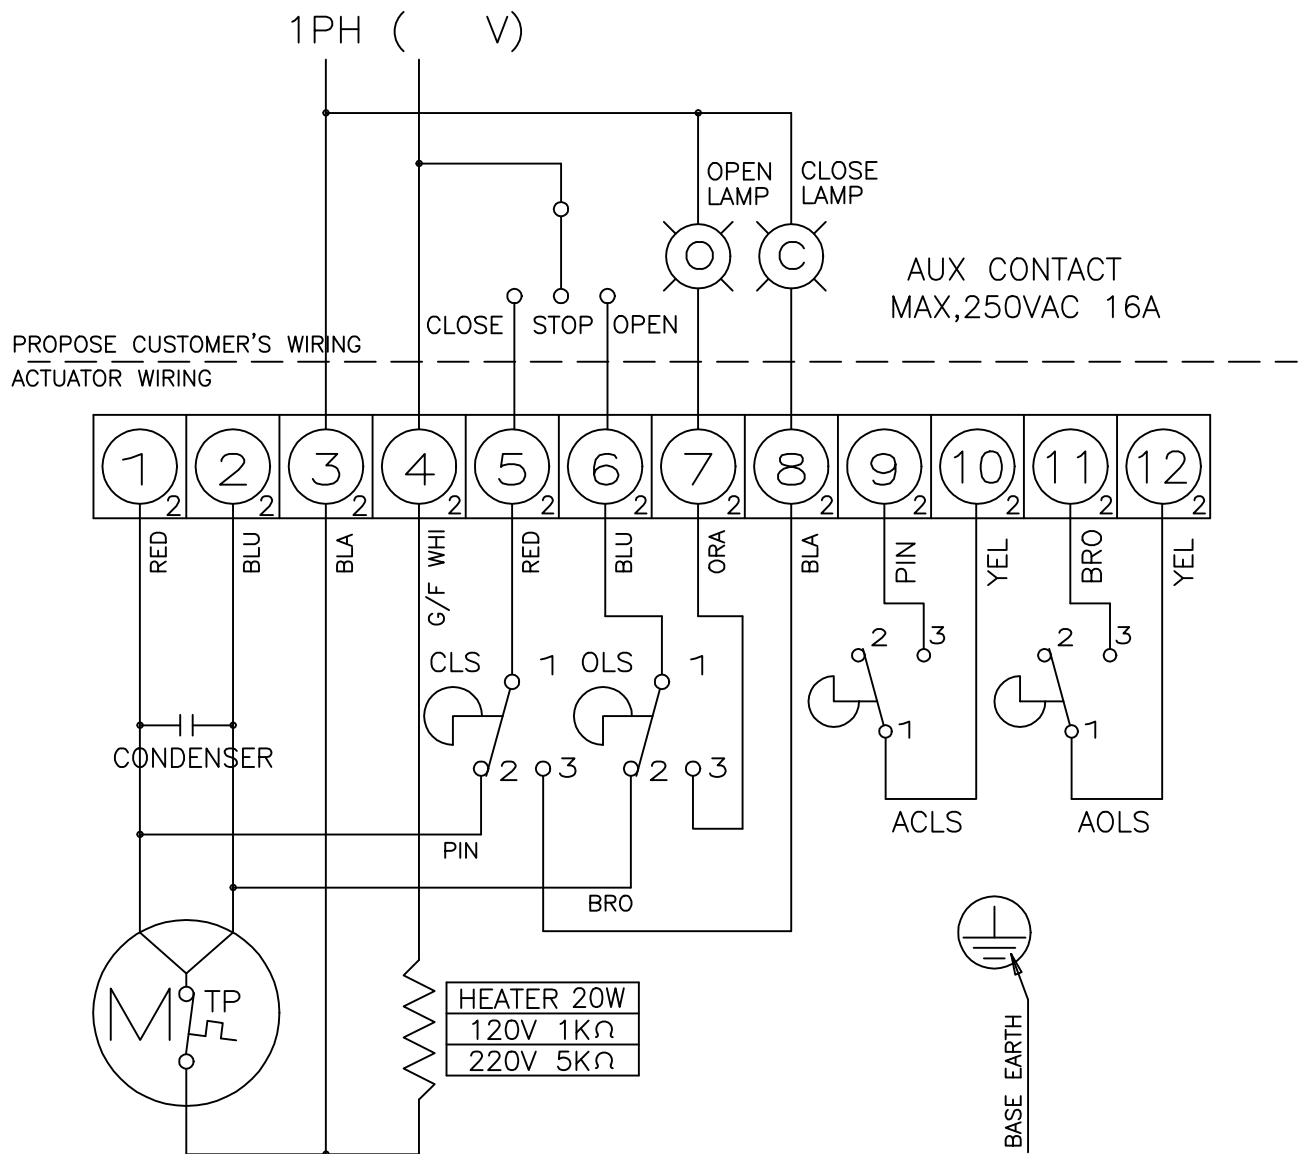

				△					
				SYM	E C N NO	CHANGES	DATE	SIGN	APPD
				DRAW	H,J KWON	PART NAME 1PH WIRING DIAGRAM ALS			
A009	1			CHECK					
A006	1			APPD		DWG NO. NU-12000-C			
APPLICATION				DATE	'19,03,05				