


CLS : CLOSE LIMIT SWITCH (250VAC 16A)
 OLS : OPEN LIMIT SWITCH (250VAC 16A)
 ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 16A)
 AOLS : AUX. OPEN LIMIT SWITCH (250VAC 16A)
 TP : THERMAL PROTECTOR (250VAC 15A)

*EACH ACTUATOR SHOULD BE POWERED THROUGH ITS OWN INDIVIDUAL SWITCH OR RELAY CONTACTS TO PREVENT CROSS FEED BETWEEN TWO OR MORE ACTUATORS

	CLOSE	OPEN
CLS 1-2		
CLS 1-3		
OLS 1-2		
OLS 1-3		
ACLS 1-2		
ACLS 1-3		
AOLS 1-2		
AOLS 1-3		

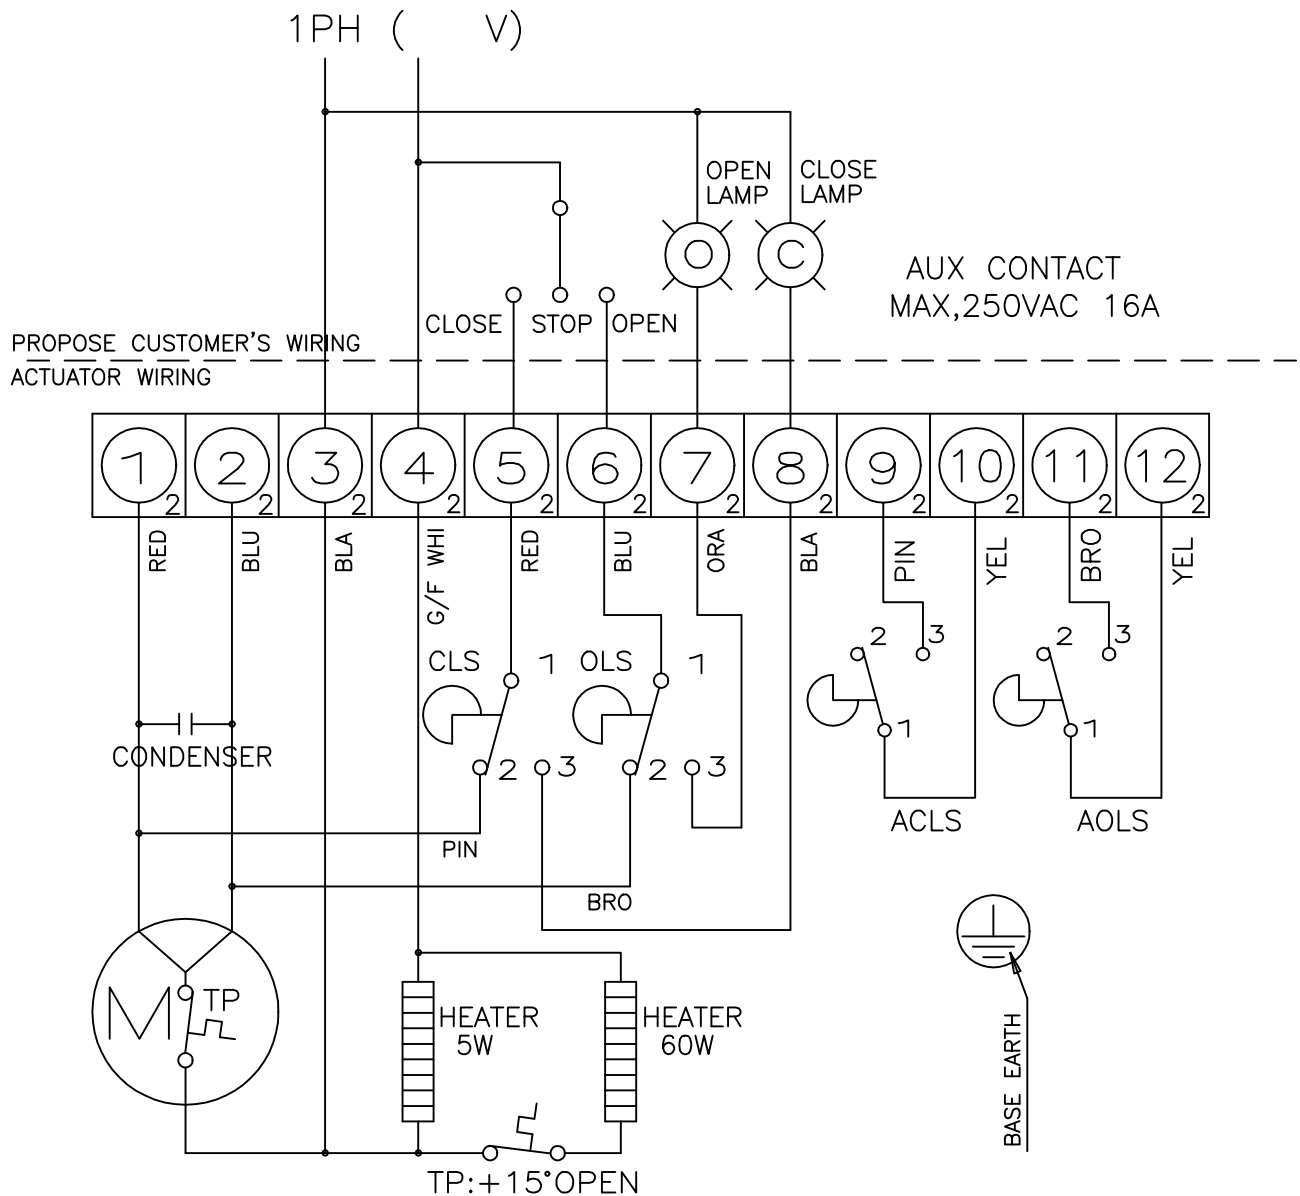

			△					
			SYM	E C N NO	CHANGES	DATE	SIGN	APPD
			DRAW	H,J KWON	PART NAME 1PH WIRING DIAGRAM ALS,TP, HEATER 60W,5W			
A009	1		CHECK					
A006	1		APPD		DWG NO. NU-1200D-6H			
APPLICATION			DATE	'11.01.21				