

**Keeping the World Flowing for Future Generations** 

# **R** series

RCx-Lx-xxxAx-8.09 user manual





# RCx-Lx-xxxAx-8.09

(12-24 VDC; Linear Drive; 4-20 mA Control)

# Hazardous Location (Only models RCx-Lx-BxxAx w/ ex-proof lid engraving)

# **USER MANUAL**

# **Contents**

INTENDED USE	3
MANUFACTURER DETAILS	3
MEANING OF SYMBOLS	3
INSTALLATION	3
Environmental Conditions  Mounting  Grounding and Securing  Wiring  Wiring for Explosion Proof Actuators	3 4 4 5 5
Wiring for Non-Explosion Proof Actuators	6
Power Supply and Current Draw Control Signal and Feedback	6 7
GENERAL SPECIFICATIONS	8
OPERATION	9
DIP switches Controlling the Actuator Changing the stroke length	9 9 10
Thrust Settings Speed and Thrust Details	11 11
Signal Loss and Calibration Troubleshooting	12 13
CERTIFICATIONS	14
Hazardous Location Rating (Ex) Electrical Compliance (EC) Electromagnetic Compatibility (EMC) Dust and Water Ingress Protection (IP)	14 15 15 15
ACTUATOR DIMENSIONS	16
PART NUMBER BREAKDOWN	17
LABEL BREAKDOWN	18

#### **INTENDED USE**

Rotork R-Series actuators are intended to be used in combination with any valve to regulate the flow automatically. The output of the actuator is rotary or linear, and is paired with the valve stem to achieve the desired flow control.

### MANUFACTURER DETAILS

Rotork manufactures the R-Series actuator at the following facilities:

Hanbay Inc. 135 Brunswick Blvd. Pointe-Claire, QC H9R5N2 Canada Fairchild Industrial Products Company 3920 West Point Blvd. Winston Salem, NC 27103 USA

### **MEANING OF SYMBOLS**



The exclamation point within an equilateral triangle is intended to alert the user to the presence of important operating and maintenance (servicing) instructions in the literature accompanying the product.



The Lightning Flash with arrowhead symbol within an equilateral triangle, is intended to alert the user to the presence of un-insulated "dangerous voltage" within the product enclosure that may be of sufficient magnitude to constitute a risk of shock to persons.

# **INSTALLATION**

The safety of any system incorporating the equipment is the responsibility of the assembler of the system.

#### **Environmental Conditions**

The R-Series actuator has an IP68 rating and is recommended for outdoor use. The relative humidity of the environment has no effect on the R-Series.

The ambient temperature range for the standard R-Series is -20 to 40 °C (-4 to 104 °F). The internal heater option shifts the temperatures to a lower range of -40 to 40 °C (-40 to 104 °F).

The standard R-Series has been approved for use at altitudes of up to 2000 m.





# **Mounting**


The holes indicated in the image are intended for a mounting bracket. They are threaded for  $\frac{1}{4}$ -20 and are 0.4" deep.

# **Grounding and Securing**

The other two visible holes are threaded 10-32, 0.50" deep, and are intended to be used to lock the lid in position (top) and as an external grounding connection (bottom) using user-supplied screws.

For detailed dimensions see p.14.

Additionally, there is a grounding connection supplied internally.

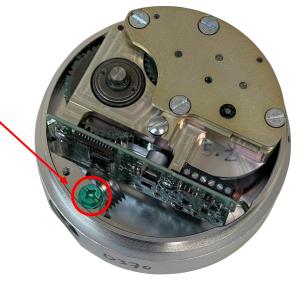

# Wiring

#### Wiring for Explosion Proof Actuators



The **RCx-Lx-BxxAx** Explosion-Proof actuator does **not** come with a pre-installed cable, nor cable gland. A cable gland that meets site specifications for the appropriate hazardous location rating is required for installation. The cable gland and the cable for hazardous location should be installed by qualified personnel in accordance with site and local requirements.

The actuator comes standard with a  $\frac{1}{2}$ " FNPT thread cable entry. See p.14 for location of  $\frac{1}{2}$ " FNPT housing access. A cable with 5 wires is required; it is recommended to use 16-24 AWG for all wires.



### Standards for cable gland and cable in hazardous locations:

Compliance Standards Required to be Met	Cable Types Permitted in Class I Division 1 Hazardous Locations
ANSI / UL 514B, ANSI / UL 1203, ANSI / UL 2225, C22.2	Non-Armored Extra Hard Usage Cord & TC-ER-HL
ANSI / UL 514B, ANSI / UL 1203, ANSI / UL 2225	Armored IEEE 45 & IEEE 1580 Marine Shipboard Cable
ANSI / UL 514B, ANSI / UL 1203, ANSI / UL 2225	MC-HI, ITC-HL
ANSI / UL 514B, ANSI / UL 1203, C22.2	Teck 90 (Canada Only)


<sup>\*</sup> In explosion-proof models, the FNPT thread is not intended for conduit connection. Cable gland only.

Once the cable and cable gland are installed, connect the wires to the pins on the terminal block as indicated here:

Pin	Function
6	+24VDC
5	Power gnd.
4	Feedback signal (4-20 mA)*
3	Not connected
2	Isolated** input signal gnd.
1	Isolated** input signal (4-20 mA)

<sup>\* &</sup>quot;feedback" available in RCx-Lx-xxxAF version only.

<sup>\*\* &</sup>quot;isolated" available in RCx-Lx-xxxAI and xxxAF versions only.

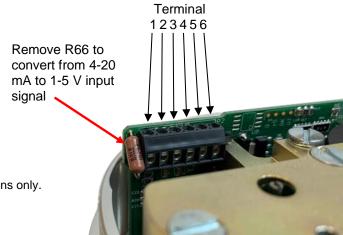

If the sensing resistor R66 is removed, we recommend placing a 10K resistor between signal and signal GND, or simply using shielded cables (for noise reduction).

## **Wiring for Non-Explosion Proof Actuators**

The actuator comes standard with a Turck 5-position connector and a 20' cable (5x 22 AWG) with plug. Cut the cable to the length required, then connect according to the following wire color schematic.

Pins indicate the connection of the cables to the terminal block on the PCB board within the actuator. These are pre-wired at the factory for non-explosion proof actuators.

#### Wire color schematic for "Turck 5" cable:

Pin	Colour	DC power supply only	
6	White	+24VDC	
5	Black	Power gnd.	
4	Grey	Feedback signal (4-20 mA) *	
3		Not connected	
2	Brown	Isolated** input signal gnd.	
1	Blue	Isolated** input signal (4-20 mA)	

<sup>\* &</sup>quot;feedback" available in RCx-Lx-xxxAF version of actuator only



Note:

Power ground must be externally connected to earth ground, or one of the case grounding screws (see INSTALLATION section) must be used to connect a grounding wire of minimum 22AWG.

# **Power Supply and Current Draw**

The **RCx-Lx-xxxAx** may be connected to voltages ranging within 12-24 VDC. The DC supply to the actuator must be limited by a 4 A fuse or circuit breaker; it is recommended to have this installed near the actuator.

The current draw will range from minimum 100 mA to maximum 3 A while the actuator is active. When not moving, the actuator draws approx. 50 mA.




<u>Note</u>:

Digital potentiometer functionality is disabled for supply voltages below 18 VDC, so the actuator position will not be retained on power-loss, on power-up the actuator will need to be re-zeroed every time.

<sup>\*\* &</sup>quot;isolated" available in RCx-Lx-xxxAI and xxxAF versions of actuator only

# **Control Signal and Feedback**

Locate the correct connection terminals/wires as shown on the previous page, then connect your input signal on positions 1 and 2 (blue and brown wires) as shown below. Feedback, if applicable is connected to position 4 (grey wire).

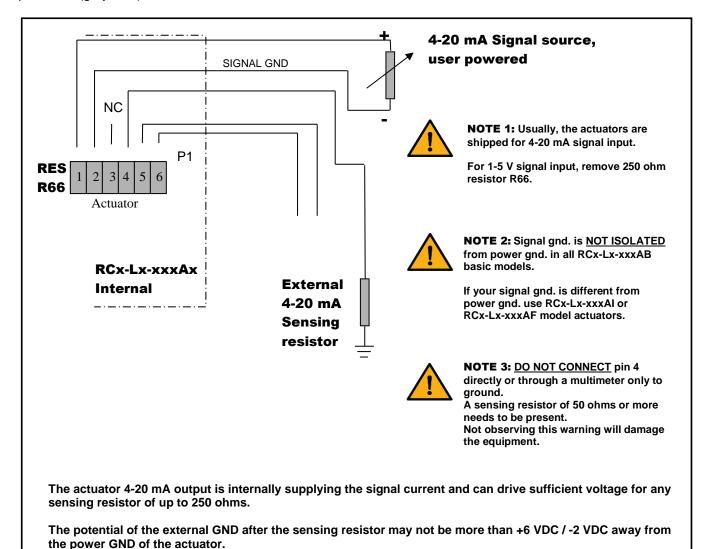

This feedback signal output is only available in RCx-Lx-xxxAF model actuators.

# **GENERAL SPECIFICATIONS**


Stall protection	Electronic position and motion detection	
Gears & Bearings	Metal and bronze, oiled/greased for life	
External fasteners	Stainless Steel	
Life Expectance	250'000 cycles in specified conditions	
Motor	Brushless DC motor, computer control	
Positioning precision	± 0.001" (0.0025 mm)	
Positioning detection	Hall detectors	
Power setting	Adjustable	
Mechanical Shock	Repeated ≤130 g-force, no effect Occasional ≤150g-force, no effect >150 g-force not tolerated	
Mechanical Vibration	Random SAE J1211, Chassis, Exterior	
Thermal Shock	-20 to +60 °C (-4 to 140 °F) in 10 min.	
Weight	RxJ, RxL, RxM: 1200 g RxH, RxF: 1920 g	
Isolated Signals (Al & AF models only)	Optical isolation min. 1000 V	
Stroke Length	Standard: 1" Options: 2" or 4"	

## **OPERATION**

#### **DIP** switches

The DIP switches allow you to change the settings on your actuator. To flip a switch, gently use a small flat-head screwdriver.

See chart on next page for DIP switch functionality.



In this example DIPs 1, 2, 5 and 12 are on.

DIP	Function
1	Speed: Choose how quickly the actuator will turn the drive wheel. See p.11.
2	
3	Not used.
4	<b>Stroke:</b> The actuator usually ships from the factory with the recommended stroke for the valve.
5	However, this value can be changed. Turning on a switch will add a specific amount of travel to the
6	actuator's stroke.
7	See p.11 for relation between position of the dip switches and stroke.
8	
	Oinmal Inco Co. a 40
9	Signal loss: See p.12.
10	Seating thrust force: Set how much torque the actuator exerts on the valve lever during the
11	calibration (finding valve seat) procedure. See p.11.
12	Direction/Calibration: Toggle switch on and off while powered to re-calibrate actuator (find valve
	seat). Also sets direction in which the actuator will open and close. See p.12.
	Example: The RCM model actuator turns clockwise when the signal is decreased with DIP 12 in the
	OFF position. Putting DIP 12 in the ON position will cause counterclockwise turning for a decrease
	in signal. For changes in DIP 12 position to take effect, the power to the actuator must be cycled.
	in signal, i or changes in Dir 12 position to take effect, the power to the actuator must be cycleu.

# **Controlling the Actuator**

The 4-20 mA (or 1-5 V / 1-10 V) input signal is proportional to the stroke of the valve.

#### Example:

You have an actuator with TPI = 16 (standard). Valve stroke is 0.75". You wish to move the actuator so the valve's position is 0.122" above the closed position:

0.122/0.750 = 0.163 20 mA - 4 mA = range of 16 mA 0.163\*16 mA = 2.608 mA + 4 mA = 6.608 mA

To get 0.122" above the closed position, supply a signal of 6.608 mA to the actuator.



# Changing the stroke length

The standard linear actuator (RCx-L1-xxxAx models) has a maximal stroke of 1", and has 16 threads per inch (TPI). With the DIP switch settings, the actual stroke can be adjusted between 0.0625" and 1" in 1/16" increments, as indicated in the table below.

Non-standard RCx-L2-xxxAx models have 8 TPI instead. The stroke of these actuator models can be adjusted between 0.125" and 1" in 1/8" increments.

Additional non-standard models with a maximal stroke of 2" & 4" are also available. For such models, use the same DIP switch settings as indicated below, and multiply the stroke by 2 or 4 (for both 16 & 8 TPI models).

16 TPI (RCx-L1 models):				
Total Stroke (DIP 4 = 0)	DIP 5	DIP 6	DIP 7	DIP 8
reserved	0	0	0	0
0.0625"	0	0	0	1
0.1250"	0	0	1	0
0.1875"	0	0	1	1
0.2500"	0	1	0	0
0.3125"	0	1	0	1
0.3750"	0	1	1	0
0.4375"	0	1	1	1
0.5000"	1	0	0	0
0.5625"	1	0	0	1
0.6250"	1	0	1	0
0.6875"	1	0	1	1
0.7500"	1	1	0	0
0.8125"	1	1	0	1
0.8750"	1	1	1	0
0.9375"	1	1	1	1

8 TPI (RCx-L	8 TPI (RCx-L2 models):				
Total Stroke (DIP 4 = 0)	DIP 5	DIP 6	DIP 7	DIP 8	
reserved	0	0	0	0	
0.125"	0	0	0	1	
0.250"	0	0	1	0	
0.375"	0	0	1	1	
0.500"	0	1	0	0	
0.625"	0	1	0	1	
0.750"	0	1	1	0	
0.875"	0	1	1	1	
1.00"	1	0	0	0	

<sup>\*</sup> Turn on DIP 4 only for 1.000" stroke.



WARNING: The stroke should not be set to exceed 1", otherwise the unit will stall. Also be sure that the stroke of the actuator is LESS than the stroke of the valve. The actuator should not stop itself on a fully opened valve. It can damage the valve, and the actuator will lose its position.

# Thrust Settings

To accommodate different valves and other applications with different thrust requirements, the actuator can be set to apply different amounts of force on the valve stem when in the seating mode.

During normal operation, the actuator will try to reach the speed set by DIP 1 and DIP 2. It will use 100% thrust to try and reach the selected speed, regardless of the positions of DIP 10 and DIP 11. Current draw is limited to 3 A regardless of settings.

### Seating power settings: (when operating at 24 VDC)

DIP 10	DIP 11	Power
OFF	OFF	16%
OFF	ON	33%
ON	OFF	66%
ON	ON	100%

To deal with sticking valves, at the beginning of the first reversing movement after the seating ("zeroing") of the valve, the actuator will apply double the power set by DIP 10 and DIP 11 (up to 100% power.) This "pull out" function is always enabled.



WARNING: High power settings can supply enough thrust to damage your valve. Please be cautious, especially when using the 100% power setting.



NOTE: 66% setting and 100% setting require voltage supply minimum values as follows:

- Supply voltage needs to be min 14 VDC for 66% setting
- Supply voltage needs to be 16 VDC for 100% setting
- When operating above 20VDC and 66% power, Duty cycle is reduced to 50% 25% maximum. At these levels, the electronics produce more heat which must be dissipated (depending on environmental temperature)

#### **Speed and Thrust Details**

The maximum speed of the actuator can be set by using the first two positions of the DIP switch selector. As a result of this setting, the actuator will limit the maximum speed. The tables below show the time required for 1" of travel.

The seating thrust depends on the voltage provided in the power connection and on the seating power settings on DIP 10, 11 as shown below. The values shown are for a 24 VDC power connection.

#### RCL-Lx-xxxAx Actuators

Speed:			
DIP 1	DIP 2	Seconds per inch	
		8 TPI	16 TPI
OFF	OFF	63	120
OFF	ON	32	64
ON	OFF	20	38
ON	ON	13	26

Thrust:				
DIP 10	DIP 11	Seating Thrust (lbs)		
		8 TPI	16 TPI	
OFF	OFF	37	13	
OFF	ON	83	44	
ON	OFF	149	88	
ON	ON	180	138	
Runnin	g Thrust	200	175	

NOTE: If actuator is RCJ-Lx-xxxAx, divide thrust values by 3. NOTE: If actuator is powered by 12 VDC, divide thrust values by 2.

To convert lbs to N, divide by 4.5.

#### RCM-Lx-xxxAx Actuators

Speed:			
DIP 1	DIP 2	Seconds per inch	
		8 TPI	16 TPI
OFF	OFF	189	360
OFF	ON	96	192
ON	OFF	60	114
ON	ON	40	78

Thrust:												
DIP 11	Seating Torque (lbs)											
	8 TPI	16 TPI										
OFF	110	35										
ON	245	128										
OFF	445	256										
ON	535	400										
g Thrust	600	517										
	OFF ON OFF ON	DIP 11         (I           8 TPI         110           ON         245           OFF         445           ON         535										

NOTE: If actuator is RCK-Lx-xxxAx, divide thrust values by 3. NOTE: If actuator is powered by 12 VDC, divide thrust values by 2. To convert lbs to N, divide by 4.5.

# **Signal Loss and Calibration**

1. **For actuators that are not connected to a UPS** (Uninterruptible Power Supply), the loss of signal will be simultaneous with power loss. Consequently, the actuator will not be able to move anywhere. In the shutdown process, the actual position is automatically saved to the internal EEPROM. [This saving of the position only happens for min. 18 VDC supplies] When power is restored, the actuator will "know" its location and will simply start to follow the signal as received.



**IF YOU HAVE TO** turn the actuator manually when its power is turned off, it will lose its position, and it will need to be re – zeroed (as described in sub-section 3).

2. For actuators that are connected to a UPS the behavior on signal loss can be set as follows:

#### Normal position of DIP 9: OFF

With DIP 9 in the off position, the actuator will ignore the signal if it is lost (i.e.: if the signal falls below 0.700 V or 2.80 mA) and simply remain in its current position.

**Note:** if the sensing resistor R66 is removed (for 1-5 V input signals), we recommend placing a 10K resistor between signal and signal GND.

#### Predetermined signal loss position DIP 9: ON

With DIP 9 in the on position, the actuator will move to a predetermined position when the signal is lost (i.e.: if the signal falls below 2.80 mA or 0.700 V).

Setting of the predetermined signal loss position:

- a.- turn DIP 9 to the "off" position
- b.- re-zero the actuator by sending and holding an input signal between 2.80 and 4.16 mA (0.700 and 1.04 V) wait until the device is re-zeroed, (i.e.: valve is closed)
- c.- by varying the input signal, move the actuator to the position that is going to be the predetermined signal loss position.
- d.- switch DIP 9 to the "on" position. The current actuator position will be saved as the default signal loss position. (The default signal position is an absolute actuator position, not a signal value.)
- 3. Re-zeroing the actuator and initiating calibration routine:

The actuator will re-zero when the input signal is between 2.80 and 4.16 mA (0.700 and 1.04 V). It will turn clockwise until the actuator has reached the fully closed position of the valve.



If the valve is removed for any reason, the calibration routine must be initiated on the actuator manually. This is done by toggling DIP 12 (switch position, then back to the original position) while the actuator is powered. This will prevent damage to the valve.

**If you need to re-zero in the opposite direction** (i.e.: for pressure regulators, which typically go to the "top" fully open position at 4 mA) change the setting of DIP 12 and cycle power.

#### 4. Feedback calibration: [RCx-Lx-xxxAF model actuators only]

The current feedback will be calibrated from the factory.

#### To re-calibrate the feedback:

- a.- Turn off the actuator and disconnect the feedback and input signals. If possible, remove the actuator from the valve.
- b.- Connect the feedback signal to the signal input. Also connect the power and signal grounds.
- c.- Power up the actuator with this "signal loop-back" setup.
- d.- Short SP1. It will automatically run a special routine to calibrate the feedback signal to the signal input. The whole process takes about 1.5 seconds.
- e.- turn off the power and reconnect the actuator as normal.

# **Troubleshooting**

Upon noticing a problem, your first step should almost always be to recalibrate the actuator by toggling DIP 12 while the actuator is powered. This alone can solve basic problems. See sub-section 3 above for more details.

#### If the actuator does not move, try following these steps:

- 1) Re-calibrate the actuator. This will move the actuator regardless of what signal it is receiving.
- 2) A sticking valve may be the problem. Remove the valve from the actuator, and re-test the actuator.
- Remove power. Re-check the wiring and the power/signal apparatus. Power actuator and re-calibrate. If the problem persists, please call Rotork for technical support.

Any parts found to be defective should be examined and/or replaced by Rotork.



#### CERTIFICATIONS

**Hazardous Location Rating (Ex)** Actuator model number: RCx-BxxAx

#### Canada:

Class I, Division 1, Groups B, C, D (T5) Class II, Division 1, Groups E, F, G (T5)

CSA C22.2 No. 30-M1986 CSA C22.2 No. 25-17

Ambient temperature range: -50°C to +40°C

\* Serial number will be engraved on lid. Lid engraving with Canadian hazardous location certification:



## International (IECEx) - available upon request:

Ex db IIB+H2 T3 Gb

IEC 60079-0:2017, 7th Edition IEC 60079-1:2014, 7th Edition

\*Serial number will be engraved on the lid.

#### USA:

Class I, Division 1, Groups B, C, D (T5) Class II, Division 1, Groups E, F, G (T5)

UL 1203 (Edition 5.0)

Ambient temperature range: -20°C to +40°C

\* Serial number will be engraved on lid. Lid engraving with USA hazardous location certification:



# **Electrical Compliance (EC)**

### Canada & USA:

CSA.UL 61010-1

#### **Europe:**

EC Declaration of Conformity (CE)
UK Declaration of Conformity (UKCA)

# **Electromagnetic Compatibility (EMC)**

#### **United States:**

FCC 47 CFR Part 15, Subpart B (Unintentional radiators), Class A

Canada:

ICES-001 Issue 5, July 2020, Class A

Europe:

**EN 61326-1:2013** (Group 1, Class A; Industrial electromagnetic environment) **IEC 61000-6-2:2016** 


IEC 61000-6-4:2018


# **Dust and Water Ingress Protection (IP)**


IP68, certified using standard IEC 60529:2013.

# **ACTUATOR DIMENSIONS**

# **RCx-Lx-xxxAx models**

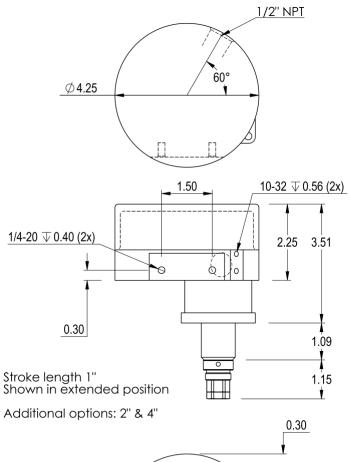







# **PART NUMBER BREAKDOWN**

Full Pa	ull Part Number:			F	R C		- Lx				Ax	]-[		-									
/	0.85	410	sure strong	2 1. 18 T		ecialOr	iors	dosire	Jand Tu	Settled Me	\$ /		ourting!			20th	Hunds			7			
	R		<i></i>	-		-					-		-			Manuf			⊃art	#/(	CU#		
												0	No Va	alve	or M	ountir	na Kit					=	
_												1	Moun	/alve or Mounting Kit nting Kit, Customer Supplies Valve,									
F	R F	R-Ser	ies									2	1	s not send valve to Hanbay ınting Kit, Customer Supplies V					Valv	e,			
	C Continuous											sends				-							
	L	D	Discr	_								3	Moun	_	Kit, I	Hanba	y Pro	ovide	es Va	alve		_	
	J Extra Lo						AB Analog Signal Board																
			L		Forque						l .		nal Boa					edba	ick				
			M		um Tor		0	01	,				nal Boa				out						
			H F	_		•	. Gear	_	<i>'</i>				ntrol w				/ 24\	/ foo	ممالم	ام داد			
				r-Ge	ai Staç	je (Au	d. Gea	ı Staç	<i>je)</i>				TTL E			-					-		
										DT24		-				-							
													L Boa							-			
													pard, L							•			
									0	No Op			1			01100,	111011						
											nal Heater												
					İ	0			Gland (Specify Cable & length at added cost)														
									ı	actua		-		_					an N	IPT i	plug		
								4	Custo	m Dua	ıl Gau	ge Cal	ble, 10	ft.									
								5	TURC	K 5 P	5 Position Connector w.					able a	nd Plu	ug					
								6	TURC	K 6 P	osition	n Conr	nector	w. 2	. 20' Cable and Plug								
								7	TURCK 5 Position Connector C						/								
								9 TURCK 6 Position Connector (							/								
										nodised	-		sure										
								Hazardous Locations-Rated															
							Stainless Steel Enclosure																
	E Stainless Steel Hazardous Locations									ations	-Rat	ed	L										
						No Special Options																	
	AC B				110-240 VAC Power Supply Battery Backup																		
	BS Bottom Stop																						
	G G-Stage Gate Valve (w						ve (wi	th MCN	/I or M	CL)													
	HT High Temperature Moun									J-)													
	L1  Linear 16 TPI						9 . 1.1	-															
	L2 Linear 8 TPI																						
	M Manual Override																						
	<b>PM</b> Position Indicator (Mul							(Multi-	turn)														
QR Quick Release Mounting																							
	RS						Reverse Spring Return																
	S Spring Return																						

## LABEL BREAKDOWN

# **Firmware Version**

AF-1.05 **[** MM = Multiturn

AB-1.05 MML = Multiturn Low Torque

AS-1.05 MMUL = Multiturn Extra Low Torque

QM = Quarter turn

QM97 = Quarter turn 97°

DT-2.01 DC-2.01

M-Dx V2.34

## **Actuator Supply Voltage**

12-24 VDC @ 3.0 A or 110-240 VAC, 50/60 Hz @ 1.5 A

# **Actuator Series**

M-Series or R-Series

# **Circuit Board Version**

Ax-8.09 Dx-10.41 Px-10.3

# rotork

www.hanbayinc.com NC. 27103

R-Series 12-24 VDC 3.0A RCM-050AB

(336) 659 3400 POWER OFF UNIT BEFORE REMOVING COVER

Made in USA



# **Actuator Part Number**

Refer to part number breakdown for available options.

# Actuator Serial Number

This serial number is unique for each individual unit and is directly tied to your order/invoice number.

### QR Code

S/N: 19103201-01

Scan this QR code for a direct link to the user manual for your unit!

As part of a process of on-going product development, Rotork reserves the right to amend and change specifications without prior notice. Published data may be subject to change. For the very latest version release, visit our website at www.rotork.com

The name Rotork is a registered trademark. Rotork recognises all registered trademarks. Published and produced in the UK by Rotork, POLJB0424