



RedBin-A... binary, switching module for switching sensors

RedBin - A1
RedBin - A2

Subject to change!

Electrical, explosion proof switching modules for switching sensors
24 VAC/DC supply voltage, output potential free switching contact
EC type-approved in acc. with ATEX directive 2014/34/EU for zone 2, 22

Compact. Easy installation. Universal. Cost effective. Safe.


Type	Channel	Supply	Output switch	Max. ratings	Wiring
RedBin - A1	1 ×	24 VAC/DC	pot. free contact	250 V, 0.1A / 30 V, 0.5 A	SB 1.0 / SB 4.0
RedBin - A2	2 ×	24 VAC/DC	pot. free contact	250 V, 0.1A / 30 V, 0.5 A	SB 2.0 / SB 4.0

Product views and applications

RedBin-A1



RedBin-A2



Description

The new RedBin-A... switching module generation (available in a 1- and 2-channel version) is a revolution for switching sensors in HVAC systems, in chemical, pharmaceutical, industrial and Offshore-/Onshore plants, for use in hazardous locations zone 2 (gas) and zone 22 (dust). Highest protection class (ATEX) and IP66 protection, small dimension, universal functions and technical data guarantee safe operation even under difficult environmental conditions.


Highlights

- ▶ For all type of gas, mixtures, vapours and dust for use in zone 2 and 22
- ▶ No additionally Ex-i module required
- ▶ Only intrinsically safe wiring/installation between switching module and sensor required
- ▶ No intrinsically safe wiring/installation and no space in the panel required
- ▶ Integrated junction box
- ▶ Power supply 24 VAC/DC
- ▶ Output potential free switching contact
- ▶ Display for switching state indication
- ▶ Fix starting bypass time for two channels
- ▶ Compact design and small dimension (L × B × H = 177 × 107 × 66 mm)
- ▶ Robust aluminium housing in protection class IP66
- ▶ Down to -20°C ambient temperature applicable



Technical data	RedBin - A...
Power supply	24 VAC/DC \pm 20% (19,2...28,8 VAC/DC) 50...60 Hz
Current, power consumption	150 mA, ~ 4 W, internal fuse 500 mA, without bracket, not removable
Galvanic isolation	supply – output 1,5 kV
Electrical connection	terminals 0,14...2,5 mm ² at integrated junction box
Cable entry	2 \times M16 \times 1,5 Ex e approved, cable diameter ~ \varnothing 5...10 mm
Protection class	Class I (grounded)
Display	Actual value indication via LEDs
Housing protection	IP66 in acc. to IEC 60529
Housing material	aluminium casting, coated
Dimension / weight	L \times W \times H = 177 \times 107 \times 66 mm / ~ 950 g
Ambient temperature/-humidity	- 20...+ 50 °C / 0...95 % rH, non condensed
Maintenance	maintenance free, nevertheless maintenance must be complied with regional standards, rules and regulations
Sensor circuit	IS circuit (data see tables)
Start delay	5 sec.
Starting bypass time (AUB)	120 sec. (fix)
Output switch	potential free switching contact
Ratings load max.	0,5 A @ 30 VAC/DC / 0,1 A @ 250 VAC / 0,1 A @ 220 VDC
Ratings load min.	10 mW / 0,1 V / 1 mA
Mechanical life	10 \times 10 ⁶
Electrical life (rated load)	100 \times 10 ³
Wiring diagram (SB)	SB 1.0, SB 2.0, SB 4.0
Installation sensor / tubing	in Ex-area zone 2, 22

Approbations	
ATEX directive	2014/34/EU
EC type-approved	EPS 14 ATEX 1 658
Approval for gas	II 3 (1) G Ex nC [ja Ga] IIC T6...T4 Gc (zone 2)
Approval for dust	II 3 (1) D Ex tc [ia Da] IIIC T80°C...T130°C Dc IP66 (zone 22)
CE identification	CE № 0158
EMC directive	2014/30/EU
Low voltage directive	2014/35/EU
Enclosure protection	IP66 in acc. to EN 60529
Protection Class	I (grounded) over voltage categorie II acc. to EN 61010-1

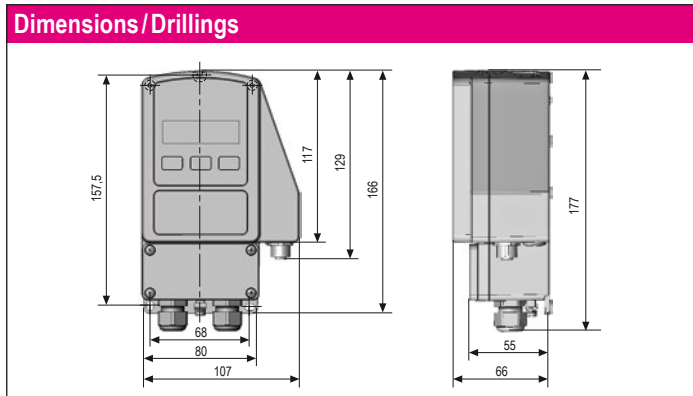

Special solutions and accessories	
...-CT	Types in aluminium housing with seawater resistant coating, parts nickel-plated
...-VA	Types in stainless steel housing, parts nickel-plated
MKR	Mounting bracket for round ducts up to \varnothing 600 mm
Kit-S8-CBR	2 cable glands M16 \times 1,5 mm, Ex-e, brass nickel-plated, for cable \varnothing 5...10 mm



Electrical connection

RedBin-A... switching modules are equipped with a 24 VAC/DC power supply. The supply has to be connected at terminal 1 (-/~) and 2 (+/~). The electrical wiring must be realized via integrated junction box. The starting bypass delay can be activated by a short circuit of terminal 2 and terminal 3 (AUB1) or terminal 2 and terminal 4 (AUB2). An active bypass delay is indicated with green blinking LEDs.

Attention: Do not open covers when circuits alive!

Connect the wires max. 0,75 mm² are acc. to diagram. After than close threat tighten The cable diameter has to be between 6-8 mm.

Connectable sensors are:


TBR-2... / TBK... / TBT... thermostats, FBR-2G / FBK-2G humiditystats

DBK... differential pressure switches, WFBK-2G airflow switch TBK-FR-2G frost protection thermostats

Wiring Ex-i output on RedBin-A switching module

Terminals

SB 4.0

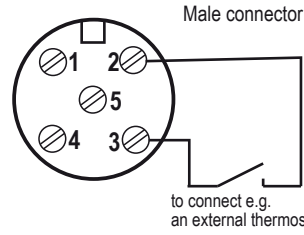

Values intrinsically safe (IS) for passive sensors

U_o = 7,14 V
I_o = 8 mA
P_o = 15 mW
C_i = 0
L_i = 0
C_o (IIC) = 5 mH
L_o (IIC) = 1,5 µF

Open the plug, connect the wires. Use terminal acc. to diagram, close tighten. Unused connectors must be covered by a protective cap against damage and dirt

Wiring Diagram RedBin-A (terminal box)

RedBin-A1 **SB 1.0** **Head/Button side of RedBin-A1**

24 VAC/DC
- +
~ ~
PE

Relay output
250VAC 0,1A / 220VDC 0,1A
30 VAC/DC, 0,5 A

If supply voltage 24 VAC/DC different from the relay voltage must be used different cables or double isolated.

AUB1

SW-IN (GND)
SW-Ch1

1 2 3 4 5 6 PA

function like connected sensor

RedBin-A2 **SB 2.0** **Head/Button side of RedBin-A2**

24 VAC/DC
- +
~ ~
PE

Relay output
250VAC 0,1A / 220VDC 0,1A
30 VAC/DC, 0,5 A

If supply voltage 24 VAC/DC different from the relay voltage must be used different cables or double isolated.

AUB1
AUB2


SW-IN (GND)
SW-Ch1
SW-Ch2

1 2 3 4 5 6 7 PA

function like connected sensor



Display



Display for state indication

Important information for installation and operation

Installation, Commissioning, Maintenance
 The cable has to be drawn through the cable gland. After electrical connection the cable gland must be fixed tight. IP66 must be fulfilled. In acc. with operation RedBin switches are maintenance free. Nevertheless maintenance must comply with regional standards, rules and regulations. The sensors must not be opened by the customer. For outdoor installation a protective housing against rain, snow and sun should be applied. For electrical connection use the internal approved Ex-e junction box.

Attention: Note the explosion proof rules before opening the internal junction box. Cut off the power supply.

A. Supply and Contact
 Wires from safety extra low voltage must be separated from others. Only at 24 VAC/DC is supply and signal wires in one cable permitted. All others use separate or double isolated cables. Install overload protection fuse < 10 A.

B. Long cabling
 For using long signal wires, shielded cables are recommended. The shield must be connected to the RedBin-... switch inside the terminal box.

C. Separate ground wires
 Use for supply and signal wires a separate ground.

Installation

Ex area Zone 2, 22 Ex safe area

Relay output	250VAC 0,1A 220VDC 0,1A 30 VAC/DC / 0,5 A
Supply	24 V AC/DC ± 20%

- Do not open covers when circuits alive
- The cable must be installed in a fixed position and protected against mechanical and thermal damage.
- Connect protection earth
- Avoid thermal transfer from sensor to transducer (ensure max ambient temperature !)
- Ambient temperature -20...+50 °C @ T6
- Close all covers, entries with min IP66
- All switching modules are maintenance free.
- Nevertheless maintenance must comply with regional standards, rules and regulations.
- Close after settings all covers and cable entries tight min. IP66.
- For outdoor installation a protective housing against rain, snow and sun should be applied
- For electrical connection use the integrated junction box.