


CLS : CLOSE LIMIT SWITCH (250VAC 16A)
OLS : OPEN LIMIT SWITCH (250VAC 16A)
ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 16A)
AOLS : AUX.OPEN LIMIT SWITCH (250VAC 16A)
TP : THERMAL PROTECTOR

		CLOSE	OPEN
CLS	1-2		
CLS	1-3		
OLS	1-2		
OLS	1-3		
ACLS	1-2		
ACLS	1-3		
AOLS	1-2		
AOLS	1-3		

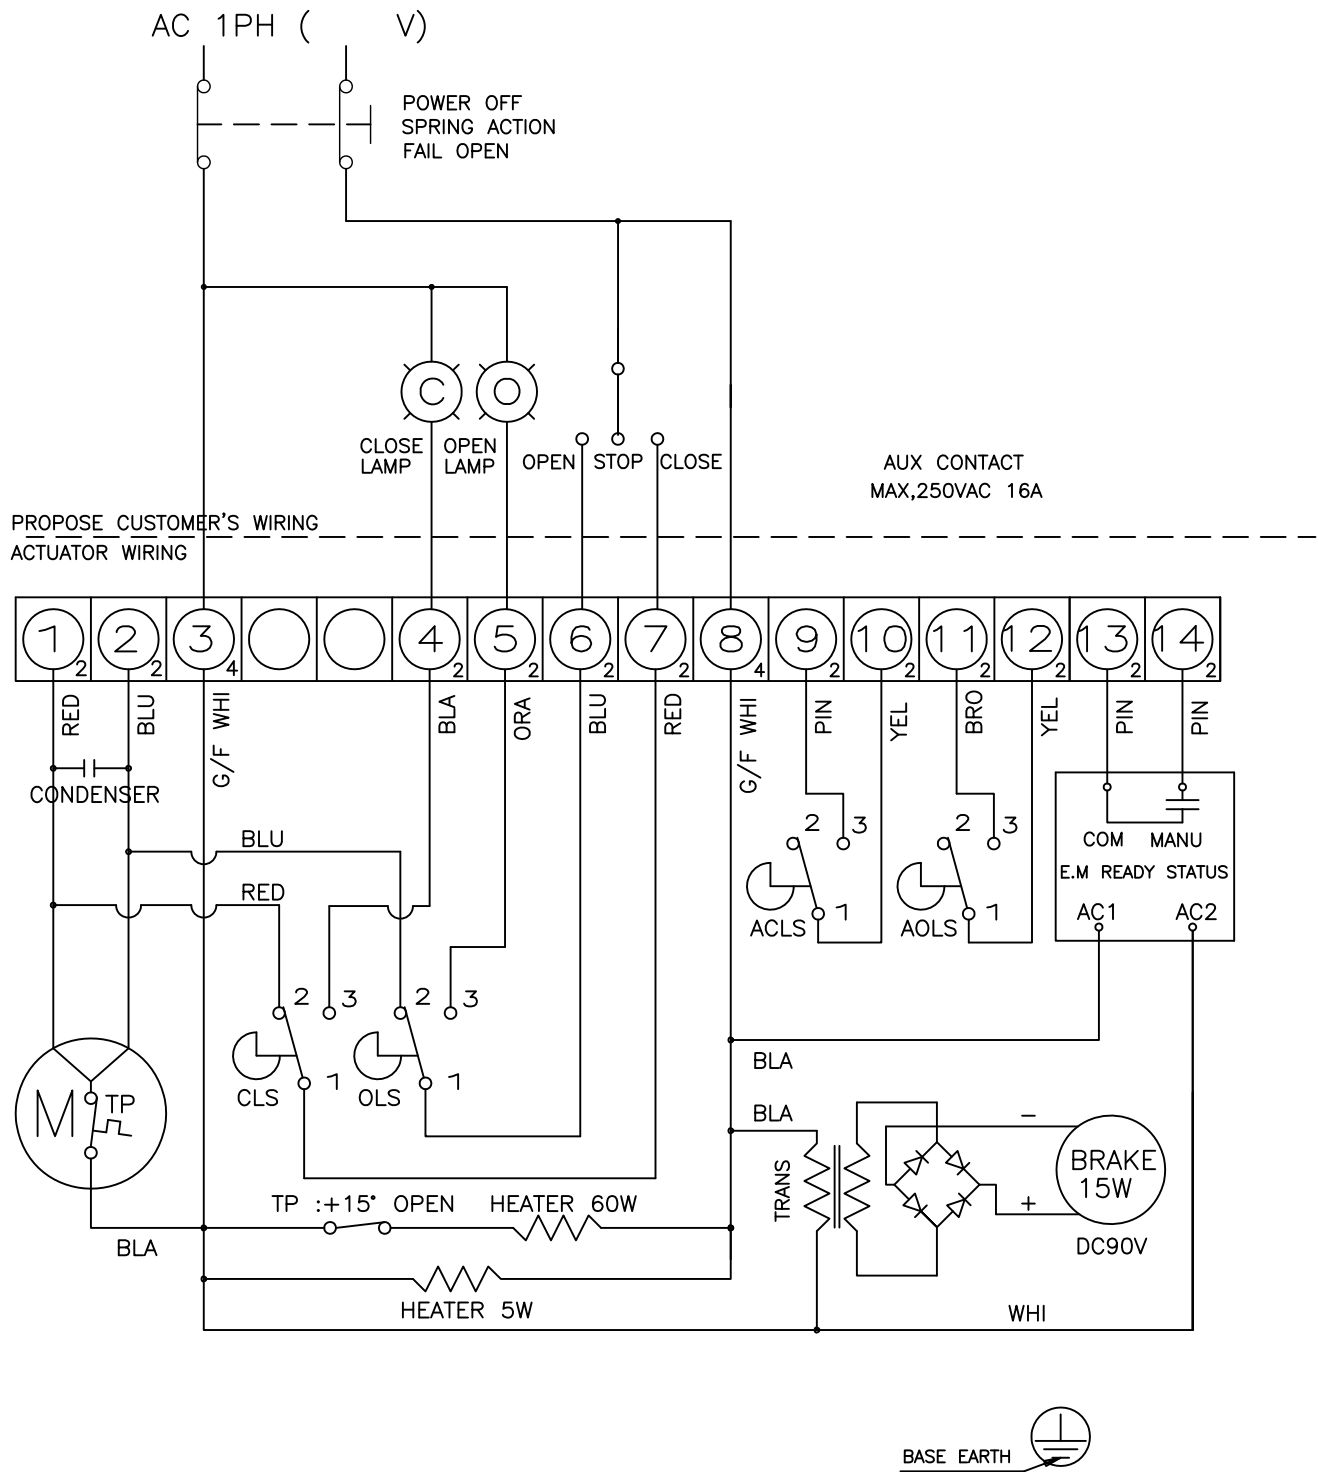

		△					
SR30	1	SYM	E C N NO	CHANGES	DATE	SIGN	APPD
SR20	1	DRAW	H.S PARK	PART NAME 1PH WIRING DIAGRAM HEATER 60/5W,FAIL OPEN			
SR10	1	CHECK					
SR05	1	APPD		DWG NO. RUO-120C-6H			
APPLICATION		DATE	21.02.23				