


CLS : CLOSE LIMIT SWITCH (250VAC 3A)
 OLS : OPEN LIMIT SWITCH (250VAC 3A)
 ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 3A)
 AOLS : AUX. OPEN LIMIT SWITCH (250VAC 3A)
 TP : THERMAL PROTECTOR

*EACH ACTUATOR SHOULD BE POWERED THROUGH ITS OWN INDIVIDUAL SWITCH OR RELAY CONTACTS TO PREVENT CROSS FEED BETWEEN TWO OR MORE ACTUATORS

SWITCH	CLOSE	OPEN
CLS		
OLS		
ACLS		
AOLS		

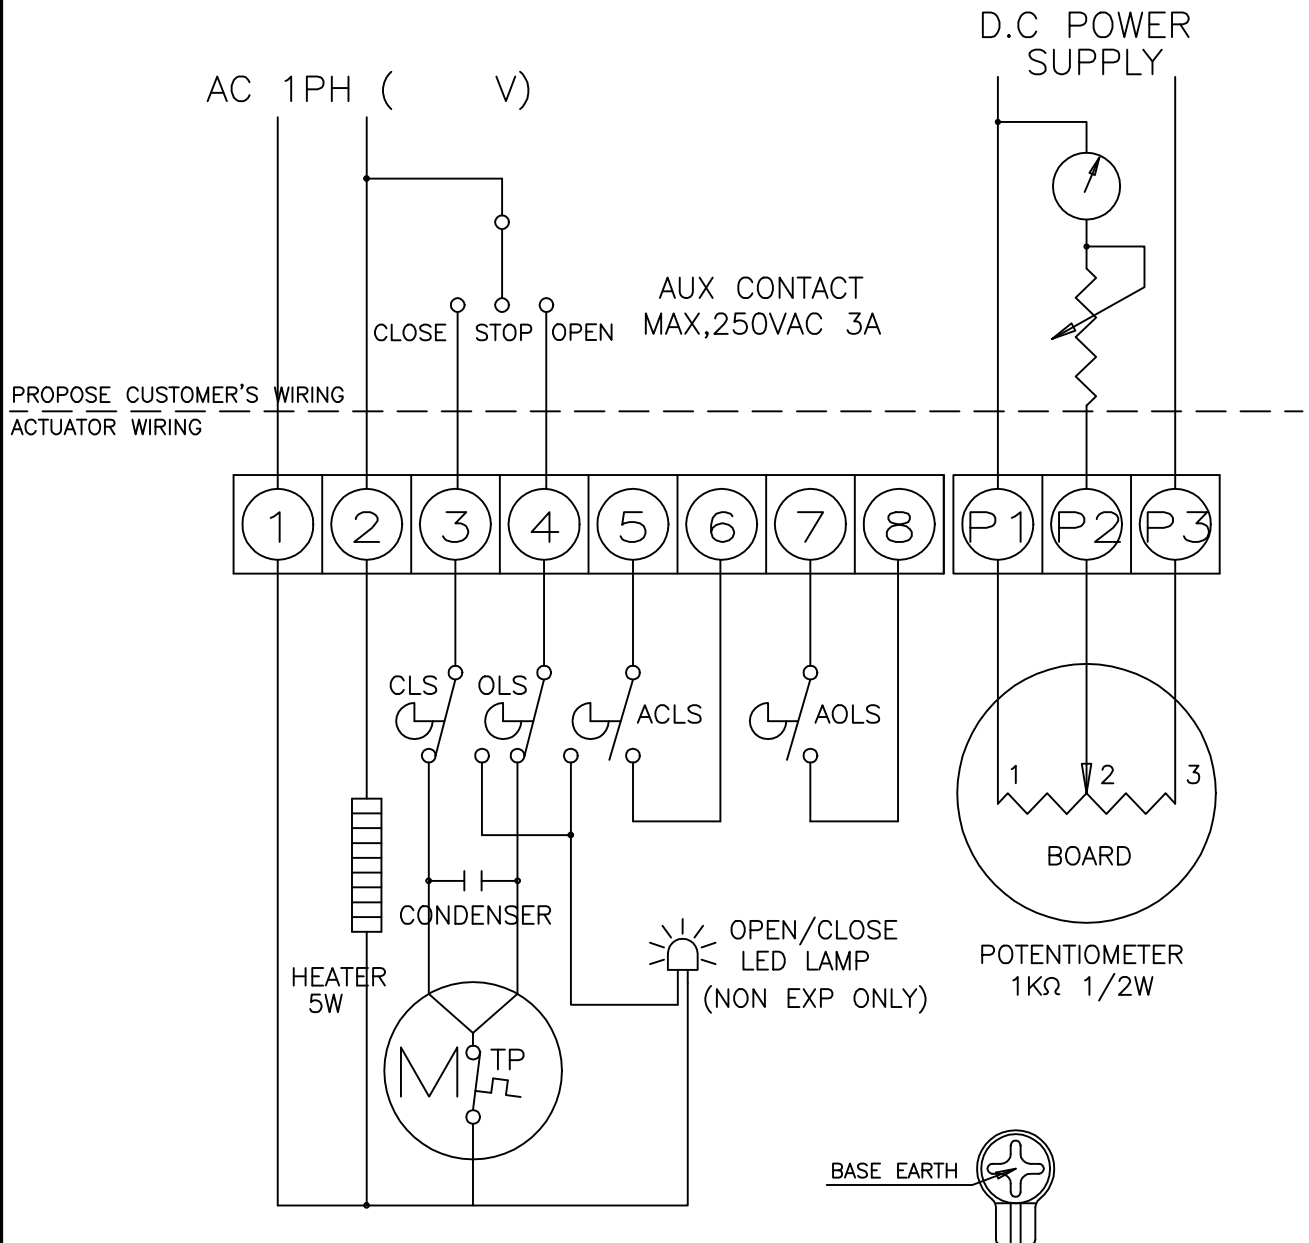

			△					
SA09L	1		SYM	E C N NO	CHANGES	DATE	SIGN	APPD
SA09	1		DRAW	H,J KWON	PART NAME 1PH WIRING DIAGRAM ALS,PIU			
SA05L	1	SA09X	CHECK					
SA05	1	SA05X	APPD					
APPLICATION			DATE	'18,10,18	DWG NO.	ST-12300-A		