
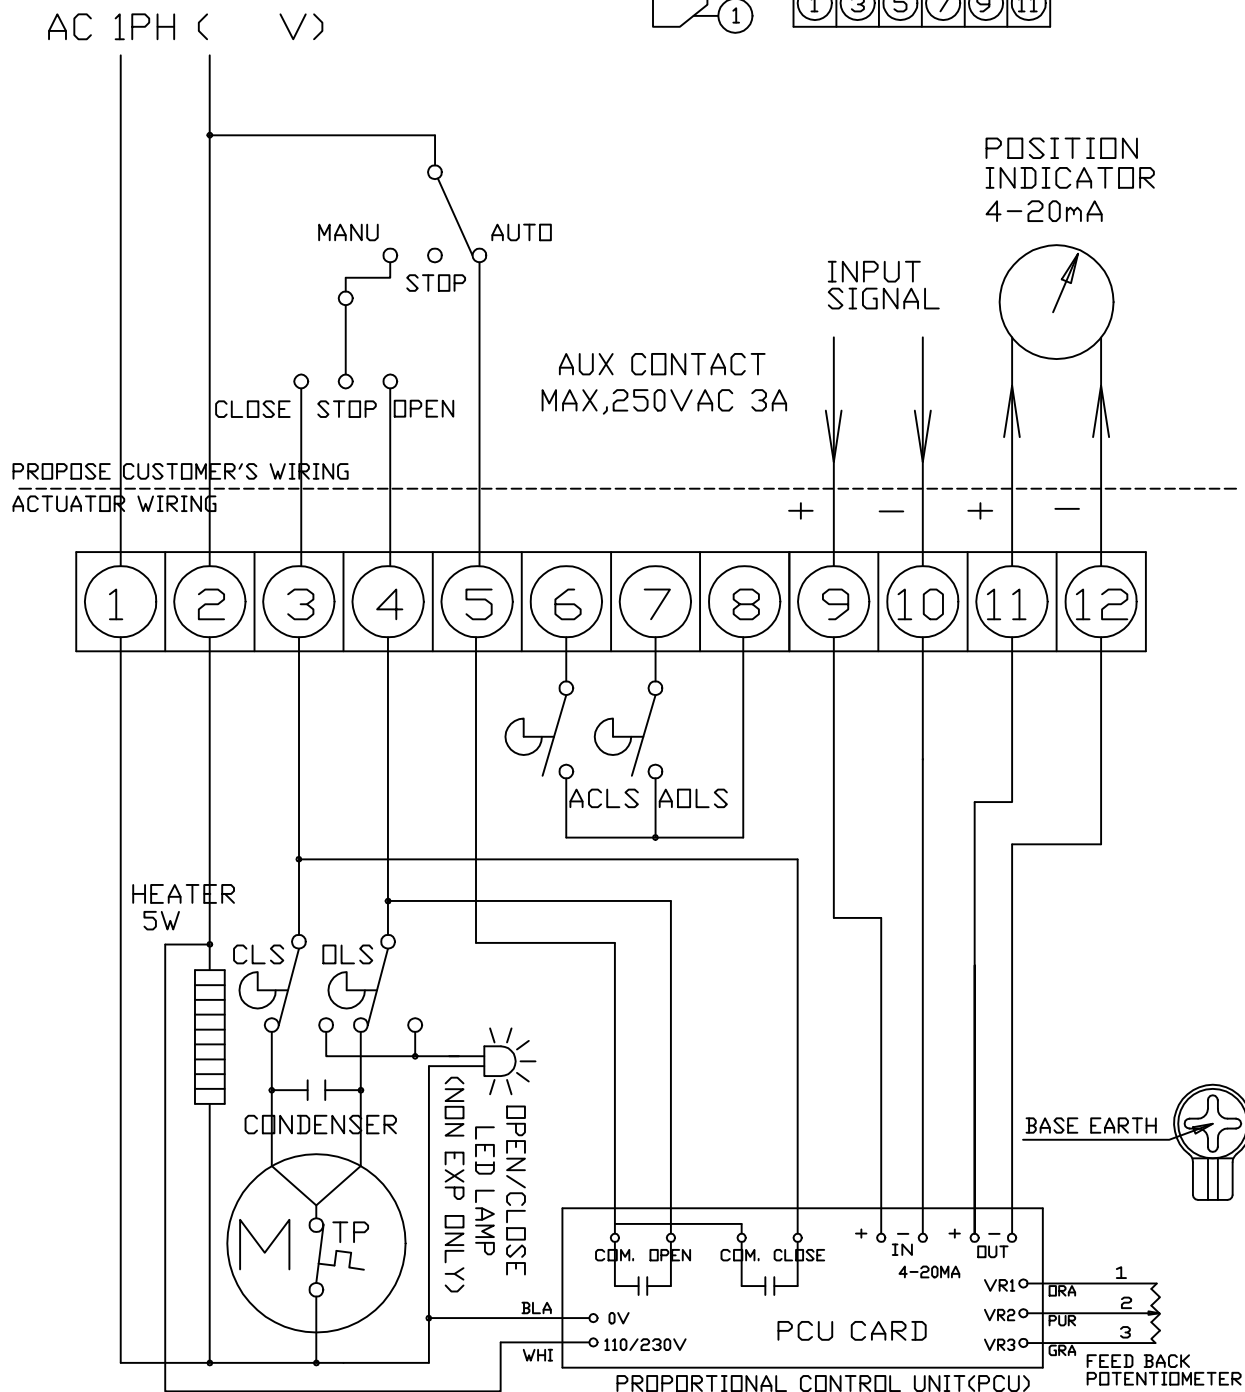


CLS : CLOSE LIMIT SWITCH (250VAC 3A)
 OLS : OPEN LIMIT SWITCH (250VAC 3A)
 ACLS : AUX. CLOSE LIMIT SWITCH (250VAC 3A)
 ADLS : AUX. OPEN LIMIT SWITCH (250VAC 3A)
 TP : THERMAL PROTECTOR

SWITCH	CLOSE	OPEN
CLS		
OLS		
ACLS		
ADLS		

*EACH ACTUATOR SHOULD BE POWERED THROUGH ITS OWN INDIVIDUAL SWITCH OR RELAY CONTACTS TO PREVENT CROSS FEED BETWEEN TWO OR MORE ACTUATORS

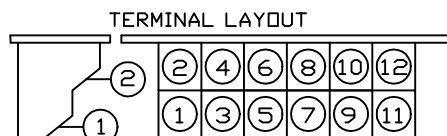

				△					
				SYM	E C N NO	CHANGES	DATE	SIGN	APPD
				DRAW	H,J KWON	PART NAME 1PH WIRING DIAGRAM ALS,PCU			
SA09L	1	SA09X	1	CHECK					
SA05L	1	SA05X	1	APPD		DWG NO. ST-12500-A			
APPLICATION				DATE	'18,10,18				